

Code of Practice for Energy Efficiency of Building Services Installations in Buildings

Preliminary Draft

*Preliminary Draft***Code of Practice for Energy Efficiency of Building Services Installations in Buildings**

<u>Table of Contents</u>	<u>Page No.</u>
1. Introduction	1
2. Interpretation of Terms	3
3. Application	9
4. Requirements of the Ordinance	11
5. Energy Efficiency Requirements for Lighting Installations	13
5.1 Scope of Application	
5.2 General Approach	
5.3 Definitions	
5.4 Lighting Power Density	
5.5 Lighting Control	
6. Energy Efficiency Requirements for Air Conditioning Installations	17
6.1 Scope of Application	
6.2 General Approach	
6.3 Definitions	
6.4 System Load Calculation	
6.5 Separate Air Distribution System for Process Requirements	
6.6 Air Distribution Ductwork Leakage Limit	
6.7 Air Distribution System Fan Power	
6.8 Pumping System Variable Flow	
6.9 Frictional Loss of Water Piping System	
6.10 System Control	
6.10.1 Temperature Control	
6.10.2 Humidity Control	
6.10.3 Zone Control	
6.10.4 Off-hours Control	
6.11 Insulation Thickness	
6.12 Air Conditioning Equipment Efficiency	
6.13 Energy Meter	

Preliminary Draft

- 7. Energy Efficiency Requirements for Electrical Installations 30
 - 7.1 Scope of Application
 - 7.2 General Approach
 - 7.3 Definitions
 - 7.4 Power Distribution Loss
 - 7.4.1 Distribution Transformer
 - 7.4.2 Main Circuit
 - 7.4.3 Feeder Circuit
 - 7.4.4 Sub-main Circuit
 - 7.4.5 Final Circuit
 - 7.5 Motor Installation
 - 7.5.1 Motor Efficiency
 - 7.5.2 Motor Sizing
 - 7.5.3 Motor for Air-conditioning Equipment and Lift & Escalator
 - 7.6 Power Quality
 - 7.6.1 Total Power Factor
 - 7.6.2 Total Harmonic distortion
 - 7.6.3 Balancing of Single-phase Loads
 - 7.7 Metering and Monitoring Facilities

- 8. Energy Efficiency Requirements for Lift & Escalator Installations 37
 - 8.1 Scope of Application
 - 8.2 General Approach
 - 8.3 Definitions
 - 8.4 Electrical Power
 - 8.4.1 Traction Lift
 - 8.4.2 Hydraulic Lift
 - 8.4.3 Escalator
 - 8.4.4 Passenger Conveyor
 - 8.5 Utilization of Power
 - 8.5.1 Total Power Factor
 - 8.5.2 Lift Decoration Load
 - 8.5.3 Lift Standby Mode
 - 8.6 Total Harmonic Distortion
 - 8.7 Metering and Monitoring Facilities

- 9. Performance Approach to comply with Energy Efficiency Requirements 45
 - 9.1 Scope of Application
 - 9.2 General Approach

Preliminary Draft

9.3	Definitions	
9.4	Basic Requirements	
9.5	Comparison of Design Energy and Energy Budget	
10.	Energy Efficiency Requirements for Major Retrofitting Work	48
11.	Requirements on Maintenance	51
	Appendix 1 – Guidelines on Calculation of Cable Loss	53
	Appendix 2 - Calculation of Total Energy Consumption in a Building or Premises Using Numerical Method for Building Energy Analysis	60

Preliminary Draft

1. Introduction

- 1.1 This Code of Practice for Energy Efficiency of Building Services Installations in Buildings, hereinafter referred to as the Code, is approved and issued under Section 39 of the Building Energy Efficiency Ordinance (subject to LegCo approval of relevant Bill), Chapter xxx, hereinafter referred to as the Ordinance.
- 1.2 The Code sets out the practical guidance and technical details in respect of the minimum energy efficiency requirements governing the relevant building services installations under the Ordinance. Building services installations designed, installed and maintained in accordance with the Code would be deemed to have complied with the Ordinance in respect of design, installation and maintenance of building services installations.
- 1.3 This Code is developed by the Electrical & Mechanical Services Department (EMSD) in conjunction with local representative professional institutions, trade associations, academia and government departments.
- 1.4 The Code may be updated from time to time by circular letters and practice notes to cope with technological advancement and prevalent trade practices, and the details of the update will be publicized and given in EMSD's web-site (<http://www.emsd.gov.hk>).

Preliminary Draft

2. Interpretation of Terms

2.1 The meanings of terms should be as given in the Ordinance and this Code, and for purpose of ready reference the meanings as given in the Ordinance on 'building services installation' and its constituent installations are extracted below -

'building services installation' means, for the purpose of this Ordinance, lighting installation, electrical installation, air-conditioning installation and lift and escalator installation, for a building.

"air-conditioning installation" means the fixed equipment, distribution network, terminals and their control devices that provide either collectively or individually the process of cooling, dehumidification, heating, humidification, air distribution or air purification or any other associated processes.

"electrical installation" means all fixed equipment, distribution network and accessories for electrical and power distribution and power utilization of a building.

"lighting installation" means all fixed electrical lighting system including general lighting, maintained type emergency lighting, illuminated directional sign and exit sign for artificial illumination but exclude non-maintained type emergency lighting.

"lift and escalator installation" has the same meaning of "lift" and "escalator" assigned by section 2 of the Lifts and Escalators (Safety) Ordinance (Cap 327).

"central building services installation" refers to the building services installation, which is provided at the occupation approval stage and includes subsequent addition and alteration of such building services installation, for a specified building listed in Part A of Schedule 1 of the Ordinance, and -

(a) in the case of a residential building or an industrial building, refers to the building services installation serving the common area of such building;

(b) in the case of the residential portion or industrial portion of a composite building, refers to the building services installation serving the common area of such portion of the composite building; or

(c) in any other specified buildings listed in Part A of Schedule 1, refers to all such building services installations.

2.2 The following give the meanings of terms cited in the Code:

Preliminary Draft

'air-conditioning' means the process of cooling, heating, dehumidification, humidification, air distribution or air purification, for human comfort purposes.

'air handling unit (AHU)' refers to an equipment that includes a fan or blower, cooling and/or heating coils, and provisions for air filtering and condensate drain etc.

'air-conditioning (AC) system' means the equipment, distribution network and terminals that provide either collectively or individually the processes of cooling, dehumidification, heating, humidification, air distribution or air-purification or any other associated processes to a conditioned space.

'appliance' means an item of current using equipment other than a luminaire or an independent motor or motor drive.

'area of a space (unit : m²)' in the context of lighting installation is measured based on the space's internal dimensions excluding thickness of wall and column.

'bed passenger lift' means a lift used for transportation of passenger and bed including stretcher.

'brake load' should have the same meaning as in the Code of Practice on the Design and Construction of Lifts and Escalators, EMSD.

'builders' lift' means a lifting machine -

- (a) that has a cage;
- (b) the operating controls for which are located inside the cage;
- (c) the cage of which is raised and lowered by means of a rack and pinion suspension system or rope suspension system; and
- (d) the direction of movement of which is restricted by guide or guides, and is used for construction work, and includes the supports, liftway and enclosures and the whole of the mechanical and electrical apparatus required in connection with the operation and safety of the builder's lift.

'CEMEP' refers to The European Commission and the Committee of Manufacturers of Electrical Machines and Power Electronics.

'chilled/heated water plant' means a system of chillers/heat pumps and/or unitary air-conditioners, with corresponding matching chilled/heated water pumps and as appropriate condenser water pumps, cooling towers and radiators.

'circuit wattage (unit : W)' in a lighting circuit means the power consumption, including lamp controlgear loss, of a lamp; circuit wattage is equal to the sum of nominal lamp wattage and lamp controlgear loss.

'circuit, feeder' means a circuit connected directly from the main LV switchboard or from the isolator just downstream of the main fuse of the electricity supplier to the major current-using equipment.

'circuit, final' means a circuit connected from a local distribution board to a current-using equipment, or to socket-outlets or other outlet points for the connection of such equipment or appliances.

'circuit, main' means a circuit connected from a distribution transformer to the main LV switchboard downstream of it.

'circuit, sub-main (sub-circuit)' means a circuit connected from the main LV switchboard, including the portion through the rising mains as appropriate, or from the isolator just downstream of the main fuse of the electricity supplier, to a local distribution board.

'coefficient of performance (COP) - cooling' means the ratio of the rate of heat removal to the rate of energy input, in consistent units, for an air-conditioning equipment.

'coefficient of performance (COP), heat pump - heating' means the ratio of the rate of heat delivered to the rate of energy input, in consistent units, for a heat pump type air conditioning equipment.

'conditioned space' means a space within boundaries maintained to operate at desired temperature through cooling, heating, dehumidification or humidification, using means other than only natural or forced fan ventilation.

Preliminary Draft

'**constant air volume (CAV) air distribution system**' refers to a system that controls the dry-bulb temperature within a space by varying the temperature of supply air that is maintained at constant volume flow to the space.

'**control valve**' in an air-conditioning installation refers to a valve that controls the flow of chilled or heated water supply to AHU or heat exchanger in response to the cooling or heating load.

'**current unbalance**' in three-phase 4-wire installation is given by:

$$I_u = (I_d \times 100) / I_a$$

where I_u = percentage current unbalance

I_d = maximum current deviation from the average current

I_a = average current among three phases

'**dead band**' means the range of values within which an input variable can be varied without initiating any noticeable change in the output variable.

'**design energy**' is the total energy consumption of the designed building modelled in accordance with the requirements given in Section 9.

'**designed building**' means the building or premises for which compliance based on the performance-based approach with the Code in Section 9 is being sought, and should include its building envelope, building services installations, and energy consuming equipment.

'**designed circuit current**' means the magnitude of the maximum design current (root-mean-square (r.m.s.) value for alternating current (a.c.)) to be carried by the circuit at its design load condition in normal service.

'**distribution transformer**' means an electromagnetic device used to step down electric voltage from high voltage distribution levels (e.g. 11kV) to the low voltage levels (e.g. 380V), rated from 200kVA, for power distribution in buildings.

'**driving controller**' means the power electronics mechanism to control the output performance including speed, rotation, torque etc. of the controlling motor.

'**dumb-waiter**' means a small service lift usually for transporting prepared meals and the like in a premises serving food.

'**DW143**' refers to "A Practical Guide to Ductwork Leakage Testing", Heating and Ventilating Contractors' Association (HVCA), UK

'**effective current-carrying capacity**' means the maximum current-carrying capacity of a cable that can be carried in specified conditions without the conductors exceeding the permissible limit of steady state temperature for the type of insulation concerned.

'**electricity supplier**' has the meaning in the Electricity Ordinance, Cap. 406.

'**emergency lighting of non-maintained type**' refers to a kind of emergency lighting that remains off until failure of normal power supply.

'**energy budget**' is the total energy consumption of the reference building modelled in accordance with the requirements given in Section 9.

'**equipment**' means any item for such purposes as conversion, distribution, measurement or utilisation of electrical energy, such as luminaires, air conditioning equipment, motors, motor drives, machines, transformers, apparatus, meters, protective devices, wiring materials, accessories and appliances.

'**escalator**' should have the same meaning assigned by Section 2 of the Lifts and Escalators (Safety) Ordinance, Cap 327.

'**fan motor power** (unit : Watt)' means the actual electrical power drawn by the motor, calculated by dividing fan shaft power/fan brake power by motor efficiency and mechanical drive efficiency.

'**fireman's lift**' should have the meaning in the Code of Practice for the Provision of Means of Access for Firefighting and Rescue Purposes, Building Authority

Preliminary Draft

'freight lift' means a lift mainly intended for the transport of goods, which are generally accompanied by persons handling the goods. A general freight lift is one which:-

- the loading in the lift will normally be evenly distributed over the floor of the car;
- the weight of any single piece of freight, or the weight of any single truck, which may be used in the loading of the lift, and the load therein, will be not more than a quarter of the rated load of the lift;
- the lift will be loaded only manually or by means of trucks which are not driven by any form of power.

'harmonics' means a component frequency of the periodic oscillations of an electromagnetic wave that is an integral multiple of the fundamental frequency, being 50 Hz for the power distribution system in Hong Kong.

'heat pump' refers to an air conditioning equipment that includes evaporator, compressor, condenser, and regulator controls, which serves to supply heated water or heated air.

'hydraulic lift' means a lift which the lifting power is derived from an electrically driven pump transmitting hydraulic fluid to a jack, acting directly or indirectly on the lift car.

'IEC' means International Electrotechnical Commission.

'IEEE' means The Institute of Electrical and Electronics Engineers, Inc.

'industrial truck loaded freight lift' is a lift which will be loaded and unloaded by industrial truck, and the loading is not necessarily evenly distributed over the floor, and the weight of any single piece of freight and its truck can exceed a quarter of the rated load of the lift.

'lamp controlgear' is a device used for starting and maintaining the operation of a lamp.

'lamp controlgear loss (unit : W)' means the power consumption of a lamp controlgear operating under the design voltage, frequency and temperature of a lighting installation, excluding the power consumption in the dimmer and for a lamp operating on low voltage the step-down transformer should the dimmer or transformer not be integral to the controlgear.

'lift' should have the same meaning assigned by Section 2 of the Lifts and Escalators (Safety) Ordinance, Cap 327, but for purpose of this Code excluding mechanized vehicle parking system.

'lift bank' means a lift system with two or more lift cars serving a zone, including lifts that may serve more than one zone but for the time in question serving the specific zone.

'lift decoration load' means the loads in a lift car for decorative purpose and not essential to lift operative functions delineated in the Code of Practice on the Design and Construction of Lifts and Escalators, EMSD, which should however exclude balancing weights in association with provision of air-conditioning to the lift car.

'lift in a performance stage' means a lift at the backstage designated to serve the performers of a show on a stage.

'lighting control point' means a lighting control device controlling the on, off or lighting level setting of a lighting installation.

'lighting power density (LPD) (unit : W/m²)' means the electrical power consumed by fixed lighting installations per unit floor area of an illuminated space, the area being measured based on the space's internal dimensions excluding thickness of wall and column.

'local distribution board' means the distribution board for final circuits to current-using equipment, luminaires, or socket-outlets.

'luminaire' refers to a lighting device, which distributes light from a single lamp or a group of lamps; a luminaire should include controlgears and all necessary components for fixing and mechanical protection of lamps.

Preliminary Draft

'luminous efficacy' (unit : lm/W)' is defined as a ratio of luminous flux emitted by a single lamp to the power consumed by the lamp; its numerical value is equal to the lamp's luminous flux divided by the nominal lamp wattage. The lamp's luminous flux refers to a value measured at prescribed initial operating hours of 100 hours.

'luminous flux' (unit : lm)' is a quantitative measure of light emitted by a light source; the quantity is derived from radiant flux (power in Watts) by evaluating the radiation in accordance with the spectral sensitivity of the standard eye as described by the CIE Standard Photometric Observer.

'main fuse' has the meaning in the supply rules of the electricity supplier.

'maximum demand' means the maximum power demand registered by a consumer in a stated period of time such as a month; the value is the average load over a designated interval of 30 minutes in kVA.

'mechanical drive' means the mechanism of a set of speed reduction gears transferring the power from the motor shaft to the drive sheave in a traction lift system or to the chain or drum drive for the pallets or steps in an escalator or conveyor system.

'mechanized vehicle parking system' should have the same meaning as in the Lifts and Escalators (Safety) Ordinance, Cap 327.

'meter' means a measuring instrument and connected equipment designed to measure, register or indicate the value of voltage, current, power factor, electrical consumption or demand with respect of time, etc.

'motor control centre (MCC)' refers to a device or group of devices in a cubicle assembly that serves to control the operation and performance of the corresponding electric motor greater than 5kW, or group of motors with at least one greater than 5kW, including starting and stopping, selecting mode of rotation, speed, torque etc., which may or may not incorporate protective devices against overloads and faults.

'motor drive' of a lift, escalator or passenger conveyor refers to the electrical motor driving the equipment plus the driving controller.

'multi-functional space' in the context of lighting installation refers to a space in which

- its different functional activities classified in terms of the various space types (listed in Table 5.6) are performed at different times, and
- the illumination for each space type is provided by a specific combination of different groups of luminaries in the space.

'nominal lamp wattage' (unit : W)' means the power consumption of a lamp, excluding the lamp controlgear loss, given by the lamp manufacturer.

'non-linear load' means any type of equipment that draws a nonsinusoidal current waveform when supplied by a sinusoidal voltage source.

'off-hour' means a time beyond normal occupancy hours.

'passenger conveyor' should have the meaning assigned by Section 2 of the Lifts and Escalators (Safety) Ordinance, Cap 327.

'passenger lift' means a lift which is wholly or mainly used to carry persons.

'power factor, displacement' of a circuit means the ratio of the active power of the fundamental wave, in Watts, to the apparent power of the fundamental wave, in Volt-Amperes, its value in the absence of harmonics coinciding with the cosine of the phase angle between voltage and current.

'power factor, total' of a circuit means the ratio of total active power of the fundamental wave, in Watts, to the total apparent power that contains the fundamental and all harmonic components, in Volt-Amperes.

'powered lifting platform' means a platform not being a lift car that can be moved up or down through a powered mechanism

Preliminary Draft

'**process requirement**' in air-conditioning means the requirement in the provision of air-conditioning for a manufacturing or industrial process other than for human comfort purpose.

'**public service escalator or passenger conveyor**' means an escalator or passenger conveyor that is part of a public traffic system including entrance and exit points (for example for connecting a traffic station and a building), and is to operate regularly for not less than 140 hours/week with a load reaching 100% of the brake load during periods lasting for at least 0.5 hour during any time interval of 3 hours.

'**rated load**' of a lift or escalator should have the same meaning as in the Lifts and Escalators (Safety) Ordinance, Cap 327.

'**rated speed**' of a lift or escalator should have the same meaning as in the Lifts and Escalators (Safety) Ordinance, Cap 327.

'**recooling**' means lowering the temperature of air that has been previously heated by a heating system.

'**reference building**' means a building design of the same size and shape as the designed building or premises, modelled in accordance with the requirements given in Section 9 and with corresponding building services installations fully satisfying the energy efficiency requirements given in Sections 5 to 8.

'**reheating**' means raising the temperature of air that has been previously cooled by a refrigeration system.

'**rising mains**' means the part of a circuit for distribution of electricity throughout a building for multiple occupation and any tee-off there from for each occupation will be provided a meter of an electricity supplier.

'**service lift**' should have the same meaning as in the Lifts and Escalators (Safety) Ordinance, Cap 327.

'**space**' in the context of lighting installation refers to a region in a building or premises that is illuminated by artificial lighting and is bounded by a physical floor, a physical ceiling and physical walls or virtual side planes to distinguish the space in question from adjoining spaces.

'**stairlift**' should have the same meaning as in the Code of Practice on the Design and Construction of Lifts and Escalators, EMSD.

'**supply water temperature reset control**' refers to the control in an air-conditioning installation where the chilled or heated water supply to AHU or fan coil unit can automatically change at a certain part load condition to a temperature setting demanding less energy consumption, and can, upon resumption of the full load condition, automatically return to the original setting.

'**surface coefficient** (symbol : h), (unit : $W/m^2 \cdot ^\circ C$)' means the rate of heat loss by a unit area of a given surface divided by the temperature difference in degree Celsius between the surface and the ambient air.

'**thermal conductivity** (symbol : λ), (unit : $W/m \cdot ^\circ C$)' means the quantity of heat that passes in unit time through unit area of a homogeneous flat slab of infinite extent and of unit thickness when unit difference of temperature in degree Celsius is established between its faces.

'**total energy consumption**' means the sum of the energy consumption of the building services installations of a building or premises, calculated over a period of one year with numerical method for building energy analysis, with calculation in accordance with Section 9.

'**total harmonic distortion** (THD)' in the presence of several harmonics, is a ratio of the root-mean-square (r.m.s.) value of the harmonics to the r.m.s. value of the fundamental expressed in percentage, in equation form the definition of %THD for current is given by:

$$\%THD = \frac{\sqrt{\sum_{h=2}^{\infty} (I_h)^2}}{I_1} \times 100$$

where : I_1 = r.m.s. value of fundamental current

I_h = r.m.s. value of current of the hth harmonic order

Preliminary Draft

'**trade-off**' in the performance-based approach in Section 9 refers to the compensation of the shortcoming of energy performance in an installation by an alternative design with better energy performance in the building.

'**unitary air-conditioner**' refers to an air conditioning equipment that includes evaporator, compressor, condenser, cooling or heating coil, air re-circulation fan section, and regulator controls, which serves to supply cooled or heated air.

'**variable air volume (VAV) air distribution system**' means a system that controls the dry-bulb temperature within a space by varying the volume of supply air to the space automatically as a function of the air-conditioning load.

'**variable refrigerant flow (VRF)**' means variable refrigerant volume flow in a unitary air-conditioner where the cooling supply to the air-conditioned space is adjusted by modulating the flow of refrigerant.

'**variable speed drive (VSD)**' of a motor means a motor drive that controls the motor speed over a continuous range.

'**vehicle lift**' means a lift which is suitably dimensioned and designed for carrying motor vehicles.

'**voltage, nominal**' means voltage by which an installation (or part of an installation) is designated. The following ranges of nominal voltage (r.m.s. values for a.c.) are defined:

- Low Voltage (LV) : normally exceeding extra low voltage but not exceeding 1000V r.m.s. a.c. or 1500V direct current (d.c.) between conductors, or 600V r.m.s. a.c. or 900V d.c. between conductor and earth.
- Extra Low Voltage : normally not exceeding 50V r.m.s. a.c. or 120V d.c., whether between conductors or conductor to earth.
- High Voltage (HV) : exceeding Low voltage.

'**chiller**' refers to an air conditioning equipment that includes evaporator, compressor, condenser, and regulator controls, which serves to supply chilled water.

'**zone**' means a space or group of spaces within a building with similar air-conditioning requirements which are considered to behave as one space for the purposes of design and control of cooling or heating system.

- 2.3 Terms that are not defined in the Code should have their ordinarily accepted meanings within the context in which they are used.

Preliminary Draft

3. Application

- 3.1 The Code is applicable to building services installations in new constructions and major retrofitting works, in specified buildings and premises stated in the Ordinance.
- 3.2 The Code is not applicable to village houses, monuments, and a certain building services installations of specified purposes as listed in Schedule 4 of the Ordinance such as for fire suppression, emergency function, surgical operation, temporary nature, research purpose, purpose of illuminating exhibit display, or in a construction site, etc.
- 3.3 To comply with the Ordinance, the building services installations save for exemption under the Ordinance, in specified buildings requiring Certificate of Compliance Registration given in Part A, Schedule 1 of the Ordinance, should be -
- (a) in accordance with the corresponding energy efficiency requirements in Sections 5 to 8 as appropriate; or as an alternative in accordance with the energy efficiency requirements in Section 9 for performance-based approach; and
 - (b) in accordance with the energy efficiency requirements in Section 11 for maintenance of installations.
- 3.4 To comply with the Ordinance, the building services installations save for exemption under the Ordinance, regarded as major retrofitting works given in Schedule 2 of the Ordinance, should be in accordance with the energy efficiency requirements in Section 10.
- 3.5 The fulfillment of the Code requirements can be demonstrated with a completion of relevant forms issued by the EMSD separately, with substantiations of -
- (a) manufacturers' technical specifications or/and publications indicating the energy efficiency performances of corresponding equipment that can be tested or assessed in the factory based on widely acceptable standards or well established practice procedures;
 - (b) designers' engineering calculations or/and operators' site measurements for energy efficiency performances of corresponding systems based on widely acceptable standards or well established practice procedures; and
 - (c) drawings required as stated in the forms.
- 3.6 In case where the meeting of a Code requirement is in conflict with any of the following, the requirement in the Code should be superceded unless otherwise explicitly specified -

Preliminary Draft

- (a) any Ordinance or Regulations of the HKSAR Government,
- (b) any of utility companies Supply Rules,
- (c) Code of Practice for the Electricity Wiring Regulation, EMSD,
- (d) Code of Practice on the Design and Construction of Lifts and Escalators, EMSD,
- (e) Code of Practice on the Examination, Testing and Maintenance of Lifts and Escalators, EMSD,
- (f) Code of Practice on the Building Works for Lifts and Escalators, EMSD,
- (g) Code of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment, Fire Services Department (FSD),
- (h) Circular Letters relating to Lift and Escalator issued by EMSD,
- (i) Circular Letters relating to Fire Service Installations issued by FSD,
- (j) Guidance Notes on Ventilation and Maintenance of Ventilation Systems, Labour Department,
- (k) Code of Practice for the Prevention of Legionnaires' Disease,
- (l) Design Manual: Barrier Free Access, Buildings Department, and
- (m) any safety, health or occupational health requirements by laws or regulations.

Preliminary Draft

4. Requirements of the Ordinance

- 4.1 Under the Ordinance, a developer of a new construction of the specified building category given in Part A of Schedule 1 of the Ordinance is required to submit to EMSD –
- (a) at the building plan approval stage [may change to consent for commencement of work – superstructure construction] a Stage 1 declaration, with certification by an authorized engineer [a different designation being considered], to confirm that the central building services installation of the building has been designed with suitable provisions for compliance with the energy efficiency requirements in the Code; and
 - (b) at the occupation approval stage, a Stage 2 declaration, with certification by an authorized engineer, to confirm that the central building services installation of the building has been installed and completed in compliance with the energy efficiency requirements in the Code.
- 4.2 EMSD will issue a Certificate of Compliance Registration for the building that has completed the Stage 2 declaration submission to signify that the concerned building has been registered for compliance with the energy efficiency requirements in the Code.
- 4.3 EMSD will maintain a register of the buildings that have been issued with Certificates of Compliance Registration, which is available for public inspection. The Certificate of Compliance Registration is subject to renewal at a time interval given in Section 17 of the Ordinance.
- 4.4 During the occupation stage of the new building, the responsible person of a premises in the building is required to arrange for certification by an authorized engineer that the building services installation, unless it has been covered in the Certificate of Compliance Registration issued for that building, completed in the premises is in accordance with the required energy efficiency requirements in the Code.
- 4.5 For major retrofitting work, as defined in Schedule 2 of the Ordinance and detailed in Section 10 of the Code, in the specified buildings, the responsible person of the premises upon completion of the works is required to arrange for certification by an authorized engineer that the building services installation as included in the major retrofitting works is in accordance with the required energy efficiency requirements in the Code.
- 4.6 No person other than an authorized engineer as registered under the Building Energy Efficiency (Registration) Regulation of the Ordinance should be allowed to carry out the duties and exercise the functions designated to be carried out by an authorized engineer

Preliminary Draft

under the Ordinance. EMSD will maintain a register of the authorized engineers.

- 4.7 The Director of Electrical & Mechanical Services is the enforcement authority of the Ordinance, who has the power to issue improvement notice requiring the rectification of non-compliance with the energy efficiency requirements as stipulated in the Code within a reasonable period, to delegate public officers to enter premises or buildings to inspect, examine and obtain information of the building service installations, and approve the Code listing the energy efficiency requirements under the Ordinance.
- 4.8 The Ordinance also imposes requirements on energy audit, which are stipulated in a separate document - Code of Practice for Energy Audit in Buildings.

Preliminary Draft

5. Energy Efficiency Requirements for Lighting Installations

5.1 Scope of Application

5.1.1 All lighting installations, unless otherwise specified, in a specified building and premises should be in accordance with the energy efficiency requirements of this Section.

5.1.2 The following installations are not governed by the energy efficiency requirements of this Section –

- (a) lighting integral to an equipment or instrumentation that is not a luminaire and with separate control switch;
- (b) lighting integral to a signage that is not an exit sign and a directional sign;
- (c) lighting installation which is included in Schedule 4 of the Ordinance

5.1.3 For the avoidance of doubt, a lighting installation should include -

- (a) all maintained type lighting installation fed by essential power supply, including those integrated in an exit sign and a directional sign.

5.2 General Approach

The requirements for energy efficient design of lighting installations are for the purposes of -

- (a) improving luminous output through imposing minimum allowable luminous efficacy in a lamp;
- (b) reducing lamp controlgear loss;
- (c) reducing lighting power through imposing maximum allowable lighting power density in a space; and
- (d) reducing energy use through proper lighting control.

5.3 Definitions

The definitions of terms applicable to Lighting Installations are given in Section 2.

5.4 Lighting Power Density

5.4.1 The lighting power density of an individual space with area exceeding 5m² classified in Table 5.4 should not exceed the corresponding maximum allowable value given in Table 5.4.

Preliminary Draft

Table 5.4 : Lighting Power Density for Various Types of Space	
Type of Space	Maximum Allowable Lighting Power Density (W/m ²)
Bar / Lounge	15
Banquet Room / Function Room / Ball Room in Hotel or Guesthouse	23
Canteen	15
Carpark	6
Circulation Area in Shopping Arcade	15
Classroom / Lecture Theatre / Training Room	17
Conference / Seminar Room	18
Confinement Cell in Place for Detention	13
Corridor	12
Dormitory / Quarters / Barrack	13
Exhibition Hall / Gallery	23
Guest room in Hotel or Guesthouse	17
Gymnasium / Exercise Room / Recreation Room	15
Jewel Shop	23
Kitchen / Pantry	13
Laboratory	17
Laundry	13
Library - Reading Area, Stack Area or Audio Visual Centre	17
Lift Lobby	15
Loading & Unloading Area	11
Mass Assembly Area / Assembly Hall	18
Medical Treatment	20
Office, Drawing	20
Office, Open Plan / Cellular	17
Patient Ward / Day Care	15
Plant Room / Machine Room / Switch Room	13
Public Transport Interchange	13
Reception / Entrance Lobby	17
Rest Room	13
Restaurant	23
Retails	20
Seating Area inside a Theatre / Cinema / Auditorium / Concert Hall / Sports Arena	18

Preliminary Draft

Table 5.4 : Lighting Power Density for Various Types of Space	
Type of Space	Maximum Allowable Lighting Power Density (W/m ²)
Space, Multi-functional Space	See below
<p>LPD of each combination of function-specific luminaires should not exceed the maximum allowable value corresponding to the type of space illuminated by that combination of luminaires, detailed as follows:</p> <p style="text-align: center;">LPD_{F1} not to exceed LPD_{S1} , LPD_{F2} not to exceed LPD_{S2} ,....., LPD_{Fn} not to exceed LPD_{Sn}</p> <p>where LPD_{F1} , LPD_{F2} ,....., LPD_{Fn} refers to the lighting power density corresponding to functions F1, F2,, Fn respectively of n different functions, and</p> <p>LPD_{S1} , LPD_{S2} ,....., LPD_{Sn} refers to the maximum allowable values of lighting power density corresponding to the classified Spaces S1, S2, ..., Sn (given under space codes A. to I. above) based on the respective functions F1, F2 ,, Fn.</p>	
Space Not Classified	18
Space with headroom over 5m (Atrium, Foyer etc.)	25
Sports Arena (Indoor) for Badminton, Basketball, Volleyball, Table Tennis, Squash, Swimming Pool, Ice Rink etc.	
• not for broadcasting	18
• for broadcasting	28
Staircase	8
Storeroom / Cleaner	11
Toilet / Washroom / Shower Room	13
Transportation Facilities	
Arrival / Departure Hall	18
Concourse / Platform with headroom not exceeding 5m	18
Concourse / Platform with headroom over 5m	25
Baggage Area	15
Vehicle Depot (for maintenance / repair / inspection)	11
Workshop	15

5.4.2 For a space with area not exceeding 5m², the sum of the lamp wattage and lamp controlgear loss of all luminaires therein should not exceed 100W.

5.5 Lighting Control

5.5.1 The minimum number of lighting control points for any space that is classified as an office should comply with requirements given in Table 5.7.

Preliminary Draft

Table 5.7 : Minimum Number of Lighting Control Points for Office Space	
Space Area A (m²)	Minimum No. of Lighting Control Points (N : integer)
$15 \times (N - 1) < A \leq 15 \times N$	$0 < N \leq 10$
$30 \times (N - 6) < A \leq 30 \times (N - 5)$	$10 < N \leq 20$
$50 \times (N - 12) < A \leq 50 \times (N - 11)$	$N > 20$

- 5.5.2 In a space with actual lighting power density value lower than the corresponding value in Table 5.6, fewer no. of control points can be provided, the percentage reduction of which should not be less than the ratio given by the difference between allowable LPD and actual LPD to the allowable LPD.
- 5.5.3 Suitable lighting control points in a multi-functional space should be provided to turn on and turn off relevant luminaries for the desired functional activity.

Preliminary Draft

6. Energy Efficiency Requirements for Air-conditioning Installations

6.1 Scope of Application

6.1.1 All air-conditioning installations, unless otherwise specified, in a specified building and premises should be in accordance with the energy efficiency requirements of this Section.

6.1.2 The following installations are not governed by the energy efficiency requirements of this Section –

(a) an air-conditioning installation which is included in Schedule 4 of the Ordinance.

6.1.3 For the avoidance of doubt, the energy efficiency requirements of this Section should apply to -

(a) all air moving equipment being part of a fire service installation but provides normal air-conditioning or ventilation to a space.

6.2 General Approach

The requirements for energy efficient design of air-conditioning installations are for the purposes of –

(a) encouraging proper sizing of air-conditioning equipment and systems by setting design conditions and imposing load estimation procedures;

(b) reducing air side distribution losses through imposing limits on air distribution system fan motor power and ductwork leakage, and conditions warranting separate distribution systems;

(c) reducing water side distribution losses through imposing limits on pipe friction loss and conditions warranting variable flow;

(d) reducing energy consumption in air-conditioning equipment through minimum allowable coefficients of performance;

(e) reducing conduction losses in pipework, ductwork and AHU casing through minimum allowable thickness on insulation thereto; and

(f) reducing the use of energy through efficient controls.

6.3 Definitions

The definitions of terms applicable to Air-conditioning Installations are given in Section 2.

Preliminary Draft

6.4 System Load Calculation

6.4.1 The air-conditioning cooling and heating load calculations should be in accordance with established internationally recognised procedures and methods.

6.4.2 The following design conditions should be used for load calculations for sizing system and equipment:

Table 6.4 : Air-conditioning System Load Design Conditions				
<u>Condition</u>	<u>Season</u>	<u>Applications</u>	<u>Temperature / Relative Humidity</u>	
Indoor, for human comfort applications	Summer	Office and Classroom	Minimum dry bulb temperature	23°C
			Minimum relative humidity	50%
		Other applications	Minimum dry bulb temperature	22°C
			Minimum relative humidity	50%
	Winter	Hotel	Maximum dry bulb temperature	24°C
			Maximum relative humidity	50%
		Other applications	Maximum dry bulb temperature	22°C
			Maximum relative humidity	50%
Outdoor	Summer	All applications	Maximum dry bulb temperature	35°C #
			#: at coincident wet bulb temperature of 26.4°C	
			Maximum wet bulb temperature	29°C
	Winter	All applications	Minimum dry bulb temperature	7°C

6.5 Separate Air Distribution Systems for Process Requirements

6.5.1 An air distribution system serving a zone with special process temperature and/or humidity requirements should be dedicated to serve the zone only and be separate from other system serving comfort only zone.

6.5.2 A special process zone can share a common air distribution system with comfort only zone and the requirement in clauses 6.5.1 needs not apply if

- (a) the supply air to the comfort zone is no more than 25% of the total air flow of the common air distribution system, or
- (b) the total conditioned floor area of the comfort zone served by the common system is smaller than 100m², or
- (c) the special process zone has separate room temperature control and requires

Preliminary Draft

no reheat of the common system supply air, and the supply air to the special process zone is no more than 25% of the total air flow of the common system.

6.6 Air Distribution Ductwork Leakage Limit

6.6.1 At least 25% in area of ductwork designed to operate at operating static pressure in excess of 750 Pa should be leakage-tested in accordance with DW143 and meet the corresponding maximum allowable air leakage limit given in Table 6.6.

Table 6.6 : Air Leakage Limit of Ductwork		
Leakage Class	Operating Static Pressure (Pa)	Air Leakage Limit (L/s per m ² of duct surface)
I	above 750 to 1000	$0.009 \times p^{0.65}$
II	above 1000 to 2000	$0.003 \times p^{0.65}$
III	above 2000	$0.001 \times p^{0.65}$
<i>p</i> is the operating static pressure in Pascal		

6.7 Air Distribution System Fan Power

6.7.1 The system fan motor power required for a constant air volume air distribution system should not exceed a limit of 1.6 W per L/s of supply system air flow.

6.7.2 The system fan motor power required for a variable air volume air distribution system should not exceed a limit of 2.1 W per L/s of supply system air flow.

6.7.3 The system fan motor power limit specified in clauses 6.7.1 and 6.7.2 refers to the sum of fan motor power of the supply air fan and return air fan of the air distribution system. The system fan motor power limit is based on the assumption that the pressure drop across air filters and any other air treatment devices in the air distribution system will not exceed 250 Pa in total, and the portion of fan power consumed due to pressure drop in excess of 250 Pa is deductible from the system fan motor power.

The portion of deductible fan motor power should be calculated as follows:

$$P_f = V \times (P_d - 250) / (\eta_m \times \eta_f \times \eta_d)$$

Where

P_f = Deductible fan motor power for air treatment/filtering (W) in excess of 250

Preliminary Draft

Pa

V = Air volume flow rate (m^3/s)

P_d = Air pressure drop (Pa) of the treatment/filtering system in clean condition

η_m = Motor efficiency

η_f = Fan efficiency

η_d = Drive/belt efficiency

6.7.4 Any individual supply or return air fan in a variable air volume air distribution system with a fan motor power of 5 kW or greater should incorporate controls and devices such that the fan motor demands no more than 55 % of design input power at 50% of design air volume.

6.7.5 The requirements in clauses 6.7.1 and 6.7.2 should not apply to

- (a) a system with system fan motor power less than 5 kW, or
- (b) a system only with air handling units with individual fan motor power less than 1 kW.

6.8 Pumping System Variable Flow

6.8.1 A water side pumping system should be designed for variable flow if its control valves are designed to modulate or step open and close as a function of load, and it should be capable of reducing system flow to 50% of design flow or less, except

- (a) where a minimum flow greater than 50% of the design flow is required for the proper operation of the equipment it serves, such as chiller, or
- (b) it has no more than one control valve, or
- (c) it incorporates supply water temperature reset control.

6.8.2 A variable speed pump with motor power of 5kW or greater should demand no more than 55% of design input power at 50% of design water volume.

6.9 Frictional Loss of Water Piping System

Water piping with diameter larger than 50 mm should be sized for frictional loss not exceeding 400 Pa/m. Water piping with diameter 50 mm or below should be sized for flow velocity of not exceeding 1.2 m/s.

6.10 System Control

6.10.1 Temperature Control

Preliminary Draft

6.10.1.1 Each air-conditioning system for cooling or heating should be provided with at least one automatic temperature control device for regulation of space temperature.

6.10.1.2 A temperature control device for comfort cooling should be capable of adjusting the set point temperature of the space it serves up to 29°C or higher.

6.10.1.3 A temperature control device for comfort heating should be capable of adjusting the set point temperature of the space it serves down to 16°C or lower.

6.10.1.4 A temperature control device for both comfort cooling and heating should be capable of providing a dead band of at least 2°C within which the supply of heating and cooling energy to the zone is shut off or reduced to a minimum, except for a temperature control device that requires manual changeover between heating and cooling modes.

6.10.2 Humidity Control

6.10.2.1 Each air-conditioning system for removing or adding moisture to maintain specific humidity levels should be provided with at least one automatic humidity control device for regulation of humidity.

6.10.2.2 A humidity control device for comfort humidification should be capable of adjusting the set point relative humidity of the space it serves down to 30%.

6.10.2.3 A humidity control device for comfort dehumidification should be capable of adjusting the set point relative humidity of the space it serves up to 60%.

6.10.3 Zone Control

6.10.3.1 Each air-conditioned zone should be controlled by a separate temperature control device for controlling the temperature within the zone.

6.10.3.2 For the purpose of clause 6.10.3.1 a zone should not include spaces on different floors, except for an independent perimeter system that is designed to offset only envelope heat gain or loss or both, where

- (a) the perimeter system includes at least one temperature control zone for each building exposure having exterior walls facing only one orientation for contiguous distance of 15 m or more, and

Preliminary Draft

- (b) the cooling and/or heating supply of the perimeter system is controlled by a temperature control device located within the zone served by the system.

6.10.3.3 Where both heating and cooling are provided to a zone, the controls should not permit the heating of previously cooled air, and the cooling of previously heated air, and should not permit both heating and cooling operating at the same time, except

- (a) for a variable air volume system which, during periods of occupancy, is designed to reduce the supply air to each zone to a minimum before reheating, recooling, or mixing of previously cooled/heated air, and the minimum volume should be no greater than 30% of the peak supply volume; or
- (b) for the reheating or recooling of outdoor air which has been previously pre-cooled or pre-heated by a primary air handling unit; or
- (c) at least 75% of the energy for reheating or for providing heated air in mixing is provided from a site-recovered or renewable energy source; or
- (d) the zone has a peak supply air flow rate of 140 L/s or less; or
- (e) where specific humidity levels are required to satisfy process requirements.

6.10.4 Off-hours Control

6.10.4.1 Each air-conditioning system with cooling or heating capacity more than 10kW should be equipped with automatic controls capable of accomplishing a reduction of energy use in the corresponding cooling or heating mode of operation through control setback or equipment shutdown during periods of non-use of the spaces served by the system.

6.10.4.2 Each air-conditioning system with cooling or heating capacity not more than 10kW may be controlled by readily accessible manual off-hour control to achieve a reduction of energy use in the corresponding cooling or heating mode of operation.

6.10.4.3 Guest Rooms in Hotel, Guest House and Hostel

Each guest room or suite with multiple rooms should be provided with a single master control device to reduce energy use during un-occupied periods. The master control device should be able to

- (a) turn off or reduce the conditioned air supply to a minimum; or
- (b) reset the temperature setting to reduce energy use; or
- (c) reset the temperature setting together with reduction of fan speed.

6.11 Insulation Thickness

Preliminary Draft

6.11.1 All chilled water pipework, suction refrigerant pipework, and ductwork carrying cooled air, and casing of air handling unit handling cooled air should be insulated with a minimum thickness calculated in accordance with the respective equation and approach in 6.11.1.1 and 6.11.1.2, for given surrounding condition and thermal conductivity of insulation of the installation.

6.11.1.1 Calculation of Insulation Thickness for Pipework

(a) Calculate using Equation 6.11(a) the provisional thickness χ (unit – mm) based on known values of the variables in Equation 6.11(a).

$$\chi = 10^3 \times \lambda/h \times \{(\theta_d - \theta_i)/(\theta_m - \theta_d)\} \dots\dots\dots \text{Equation 6.11(a)}$$

where h = Surface coefficient of external surface of insulation - W/(m² °C)

λ = Thermal conductivity of insulating material - W/(m °C)

θ_d = Dew point temperature - °C

θ_i = Temperature of the cold surface (line temperature) - °C

θ_m = Temperature of the ambient still air - °C

(b) Roughly estimate the value of L_a based on general engineering practice, and calculate using Equation 6.11(b) the provisional thickness χ (unit – mm) based on known values of the variables in Equation 6.11(b).

$$\chi = 0.5 (d_o + 2L_a) \times \ln [1 + 2L_a/d_o] \dots\dots\dots \text{Equation 6.11(b)}$$

where L_a = Estimated minimum thickness – mm, which will converge to become the actual value through iterations

d_o = Outside diameter of pipe or tube – mm

(c) Compare the two calculated values of thickness in (a) and (b). The estimated L_a value will be deemed to be the actual thickness if the two χ values are reasonably close to each other. Should the two values not be reasonably close, conduct an iteration of Equation 6.11(b) with another estimated likely converging value of L_a .

6.11.1.2 Calculation of Insulation Thickness for Ductwork and AHU Casing

Calculate using Equation 6.11(a) the thickness χ (unit – mm) based on known values of the variables in Equation 6.11(a).

6.11.2 As an alternative to clause 6.11.1 the insulation thickness should be in accordance with the corresponding value given in Tables 6.11a to 6.11d, for the given

Preliminary Draft

surrounding condition and thermal conductivity of insulation of the installation.

Table 6.11a : Minimum Insulation Thickness for Chilled Water Pipework								
Minimum Thickness of Insulation (mm)								
Pipework Surrounding Condition	Indoor Condition (still air)				Outdoor Condition (wind speed = 1m/s)			
Thermal Conductivity $\lambda^{(2)}$	0.024 W/(m °C.)		0.04 W/(m °C.)		0.024 W/(m °C.)		0.04 W/(m °C.)	
Nominal Pipe size (mm) ⁽¹⁾	28°C, 80%RH	30°C, 95%RH	28°C, 80%RH	30°C, 95%RH	35°C, 95%RH			
$h^{(3)(4)}$	5.7	10	5.7	10	9	13.5	9	13.5
15	15	35	22	51	43	32	64	47
20	15	36	23	54	46	33	67	49
25	16	38	24	57	48	35	71	52
32	17	40	25	60	50	37	75	55
40	17	41	26	61	52	38	77	57
50	18	43	27	64	54	40	81	59
65	18	45	28	68	57	41	85	62
80	19	47	29	70	59	42	88	64
100	19	49	30	73	62	44	93	67
125	19	50	30	76	64	46	97	70
150	20	52	30	79	66	47	100	72
200	20	54	32	83	69	49	105	75
250	20	55	32	85	71	50	109	78
300	21	56	33	88	72	51	112	80
350	21	57	33	89	73	51	114	81
400	21	57	33	90	74	52	116	82

Notes:

- (1) The above table assumes pipes to be steel pipe of BS EN 10255 or BS EN 10220. For other metal pipes, same insulation thickness should be applied to comparable outer diameters.
- (2) The insulation thickness is based on thermal conductivity rated at 20°C mean for fluid operating temperature of 5°C.
- (3) For indoor pipework, the surface coefficient $h=5.7$ is assumed for bright metal surfaces and $h=10$ for cement or black matt surfaces at indoor still air condition.
- (4) For outdoor pipework the surface coefficient $h=9$ is assumed for bright metal surfaces and $h=13.5$ for cement or black matt surfaces at outdoor condition with a wind speed of 1m/s.

Preliminary Draft

Table 6.11b : Minimum Insulation Thickness for Indoor Refrigerant Pipework									
Minimum Thickness of Insulation (mm)									
Thermal Conductivity λ ⁽²⁾	0.02	0.03	0.04	0.02	0.03	0.04	0.02	0.03	0.04
Pipework Surrounding Condition - 28 °C, 80% RH; still air; $h^{(3)}=10$									
Diameter of Pipe (mm) ⁽¹⁾	Fluid Operating Temperature								
	0°C			-10°C			-20°C		
6	8	10	13	10	13	16	12	16	20
8	8	11	14	10	14	18	13	17	21
10	8	11	14	11	15	18	13	18	22
12	9	12	15	11	15	19	14	19	23
15	9	12	15	12	16	20	14	20	25
22	10	13	17	13	18	22	16	21	27
28	10	14	18	13	18	23	16	22	28
35	10	15	18	14	19	24	17	23	29
42	11	15	19	14	20	25	18	24	30
54	11	15	20	15	21	26	18	25	32
76	11	16	21	15	22	28	19	27	34
Pipework Surrounding Condition - 30 °C, 95% RH; still air; $h^{(3)}=10$									
Diameter of Pipe (mm) ⁽¹⁾	Fluid Operating Temperature								
	0°C			-10°C			-20°C		
6	26	36	44	33	45	56	39	53	67
8	28	38	47	35	48	60	42	57	71
10	29	40	50	37	50	62	44	60	75
12	31	42	52	38	52	65	45	62	78
15	32	44	54	40	55	68	48	65	81
22	35	48	59	44	60	74	52	71	89
28	37	50	63	46	63	79	55	75	94
35	39	53	66	49	66	83	58	79	99
42	40	55	69	51	69	86	60	82	103
54	42	58	73	53	73	91	64	87	109
76	45	63	78	57	79	99	69	94	118
Notes:									
(1) The above table assumes pipes to be copper pipe of BS EN 12449. For other metal pipes, same insulation thickness should be applied to comparable outer diameters.									
(2) The insulation thickness is based on thermal conductivity rated at 20°C mean.									
(3) The surface coefficient $h=10$ is assumed for cement or black matt surfaces at indoor still air condition.									

Preliminary Draft

Table 6.11c : Minimum Insulation Thickness for Outdoor Refrigerant Pipework									
Minimum Thickness of Insulation (mm)									
Thermal Conductivity λ ⁽²⁾	0.02	0.03	0.04	0.02	0.03	0.04	0.02	0.03	0.04
Pipework Surrounding Condition - 35 °C, 95% RH; wind speed = 1m/s; $h^{(3)}=13.5$									
Diameter of Pipe(mm) ⁽¹⁾	Fluid Operating Temperature								
	0°C			-10°C			-20°C		
6	23	32	40	29	39	49	33	46	57
8	25	34	42	30	41	52	36	49	61
10	26	36	45	32	44	54	38	51	64
12	27	37	46	33	45	57	39	53	66
15	29	39	49	35	48	59	41	56	70
22	31	43	53	38	52	65	45	61	76
28	33	45	56	40	55	69	48	64	80
35	35	48	59	42	58	72	50	68	85
42	36	49	62	44	60	75	52	71	88
54	38	52	65	46	64	80	55	75	93
76	41	56	70	50	69	86	59	80	101

Notes:

(1) The table assumes pipes to be copper pipe of BS EN 12449. For other metal pipes, same insulation thickness should be applied to comparable outer diameters.

(2) The insulation thickness is based on thermal conductivity rated at 20°C mean.

(3) The surface coefficient $h=13.5$ is assumed for cement or black matt surfaces at outdoor condition with a wind speed of 1 m/s.

Table 6.11d : Minimum Insulation Thickness for Ductwork and AHU Casing				
Minimum Thickness of Insulation (mm)				
Maximum Temperature Difference ⁽¹⁾	Thermal conductivity ⁽²⁾ λ W/(m .°C)			
	0.024	0.04	0.055	0.07
15°C max. for indoor condition at 80%RH; still air; $h^{(3)}=5.7$	13	21	29	37
15°C max. for indoor condition at 95%RH; still air; $h^{(3)}=10$	43	72	99	126
20°C max. for outdoor condition at 95%RH; wind speed = 1m/s; $h^{(3)}=13.5$	38	63	87	110

*Preliminary Draft***Table 6.11d : Minimum Insulation Thickness for Ductwork and AHU Casing**

Notes :

- The maximum temperature difference at design conditions is the greatest temperature difference between the space within which the duct is located and the design temperature of the air carried by the duct. Where the duct is used for both heating and cooling purposes, the larger temperature difference should be used.
- The insulation thickness is based on thermal conductivity rated at 20°C mean.
- The surface coefficient $h=5.7$ is assumed for bright metal surfaces at indoor still air condition; $h=10$ for cement or black matt surfaces at indoor still air condition and $h=13.5$ for cement or black matt surfaces at outdoor condition with a wind speed of 1 m/s.

6.12 Air-conditioning Equipment Efficiency

6.12.1 A factory-designed and pre-fabricated electrically-driven equipment shown in Tables 6.12a or 6.12b should have the corresponding minimum coefficient of performance at the specified rating condition given in the table.

6.12.2 A room air conditioner of the types under the scope of The Hong Kong Voluntary Energy Efficiency Labelling Scheme for Room Coolers, EMSD, or governed by the Code of Practice on Energy labeling of Products, EMSD, should fulfill the requirements of Energy Efficiency Grade 3 or above.

Table 6.12a : Minimum Coefficient of Performance for Unitary Air-conditioner

Type of Cooling	Air-cooled				Water-cooled
Capacity Range (kW)	7.5 kW & below, of types outside the scope of Room Air Conditioners in the labelling schemes in Clause 6.12.2	Above 7.5 kW & below 40 kW	40 to 200 kW	Above 200 kW	All Ratings
Minimum COP at cooling mode (free air flow)	2.4 for split type 2.1 for non-split type	2.4 3 for VRF	2.6 2.9 for VRF	2.6 2.9	3
Minimum COP at heat pump mode (free air flow)	2.4	2.7	2.8	2.9	(not applicable)
Standard Rating Conditions					
Mode	Air-cooled		Water-cooled		
	Condenser Ambient	Room Air Entering Equipment	Entering Water Temperature	Room Air Entering Equipment	
Cooling	35°C d.b.	26.7°C d.b./ 19.4°C w.b.	29.5°C	26.7°C d.b./ 19.4°C w.b.	

Preliminary Draft

Heating	7°C d.b. / 6°C w.b.	21°C d.b.	(not applicable)
Water Side Fouling Factor	0.000018m ² -°C/W for evaporator; 0.000044m ² -°C/W for condenser		

Table 6.12b : Minimum Coefficient of Performance for Chiller													
<u>Air-cooled</u>													
	Reciprocating		Scroll			Screw			Centrifugal				
Capacity Range (kW)	Below 400 kW	400 kW & above	All Ratings			All Ratings			All Ratings				
Minimum COP at cooling (free air flow)	2.6	2.8	2.7			2.9			2.8				
<u>Water-cooled</u>													
	Reciprocating			Scroll			Screw			Centrifugal			
Capacity Range (kW)	Below 500 kW	500 to 1000 kW	Above 1000 kW	Below 500 kW	500 to 1000 kW	Above 1000 kW	Below 500 kW	500 to 1000 kW	Above 1000 kW	Below 500 kW	500 to 1000 kW	Above 1000 kW	
Minimum COP (Cooling)	3.4	3.9	4.1	4	4.5	5.2	4.6	4.6	5.5	4	4.5	5.7	
<u>Standard Rating Conditions</u>													
Mode	Air-cooled					Water-cooled							
	Condenser Ambient Temperature	Chilled Water Temperature		Condenser Water Temperature				Chilled Water Temperature					
		In	Out	Fresh water		Sea water		In	Out				
Cooling	35°C	12.5°C	7°C	32°C	37°C	28°C	33°C	12.5°C	7°C				
Water Side Fouling Factor	Evaporator					0.000018m ² -°C/W							
	Condenser					Fresh water		0.000044m ² -°C/W		Sea water			0.000088m ² -°C/W

6.12.3 When components from more than one manufacturer are used as parts of an air-conditioning equipment with a rating above 10 kW of cooling/heating capacity,

Preliminary Draft

the overall system coefficient of performance, based on component efficiencies provided by the component manufacturers, should also satisfy the requirements of clause 6.12.1.

6.13 Energy Meter

6.13.1 A unitary air-conditioner or chiller of not less than 350 kW cooling/heating capacity should be equipped with metering facilities to indicate or derive the electrical input in kW and kWh to the equipment and its output of cooling/heating energy in kW and kWh.

6.13.2 A chilled/heated water plant of not less than 350kW cooling/heating capacity should be equipped with metering facilities to indicate the electrical input in kW and kWh to the plant and its output of cooling/heating energy in kW and kWh.

Preliminary Draft

7. Energy Efficiency Requirements for Electrical Installations

7.1 Scope of Application

7.1.1 All electrical installations, unless otherwise specified, in a specified building and premises should be in accordance with the energy efficiency requirements of this Section.

7.1.2 The following installations are not governed by the energy efficiency requirements of this Section –

- (a) an electrical installation which is operated at high voltage or extra low voltage;
- (b) an electrical installation in a building of which the total rating of the main electrical switch governing the electricity supply of that building does not exceed 100A;
- (c) an electrical installation of which the equipment is owned by the electricity supplier and installed in a consumer's substation; and
- (d) an electrical installation which is included in Schedule 4 of the Ordinance;

7.1.3 For the avoidance of doubt, the energy efficiency requirements of this Section should apply to -

- (a) all circuits in lighting installation, in air-conditioning installation, or in lift & escalator installation, or all circuits with fixed motors such as for plumbing or drainage; and
- (b) all circuits fed by essential power supply and provide supply to routine operating equipment or installation such as maintained type emergency lighting, fireman's lift etc.

7.2 General Approach

The approach on energy efficiency is through both design and monitoring. The approach on design aims to select energy efficient components to be integrated into the electrical installation, and the approach on monitoring aims to provide required information for better energy utilization and management.

7.2.1 The requirements for energy efficient design of electrical installations are for the purposes of -

- (a) minimizing losses such as iron losses, copper losses, losses due to phase current unbalance and harmonics, and indirect losses due to rise of temperature in the power distribution system; and

Preliminary Draft

(b) reducing losses and energy wastage in the utilization of electrical power;

7.2.2 The requirements for energy efficient monitoring facilities of the electrical installations are for the purposes of -

- (a) getting required energy consumption data for better energy utilization and management;
- (b) identifying possible power quality problems so that appropriate solution can be taken to reduce the losses; and
- (c) facilitating energy audits.

7.3 Definitions

The definitions of terms applicable to Electrical Installations are given in Section 2.

7.4 Power Distribution Loss

7.4.1 Distribution Transformer

A distribution transformer other than that owned by the electricity supplier should have a minimum efficiency given in Table 7.4.1 and be tested in accordance with IEC Standard 60076-1 Ed. 2.1, at the test conditions of full load, free of harmonics and at unity displacement power factor.

Table 7.4.1 : Minimum Transformer Efficiency	
Transformer Capacity	Efficiency
< 1000kVA	98%
≥ 1000kVA	99%

7.4.2 Main Circuit

7.4.2.1 The copper loss of a main circuit connecting the distribution transformer and the main incoming circuit breaker of a LV switchboard should not exceed 0.5% of the total active power transmitted along the circuit conductors at designed circuit current.

7.4.2.2 As an alternative to 7.4.2.1 the transformer room and the corresponding main switch room should be right beside, above or below each other.

7.4.2.3 The effective current-carrying capacity of the neutral conductor in a main circuit should

Preliminary Draft

have a rating not less than that for the corresponding phase conductors.

7.4.3 Feeder Circuit

The maximum copper loss in a feeder circuit should not exceed 2.5% of the total active power transmitted along the circuit conductors at designed circuit current. This requirement does not apply to circuits used for compensation of reactive and distortion power.

7.4.4 Sub-main Circuit

7.4.4.1 The maximum copper loss for non-residential buildings in a sub-main circuit not exceeding 100 m length should not exceed 1.5% of the total active power transmitted along the circuit conductors at designed circuit current.

7.4.4.2 The maximum copper loss for non-residential buildings in a sub-main circuit exceeding 100 m length should not exceed 2.5% of the total active power transmitted along the circuit conductors at designed circuit current, subject to the sum of losses in sub-main circuit and final circuit over 32A (based on circuit protective device rating) not exceeding 2.5%.

7.4.4.3 The maximum copper loss for residential buildings in a sub-main circuit should not exceed 2.5% of the total active power transmitted along the circuit conductors at designed circuit current.

7.4.5 Final Circuit

The maximum copper loss for a final circuit over 32A (based on circuit protective device rating) should not exceed 1% of the total active power transmitted along the circuit conductors at designed circuit current.

7.4.6 The calculation of copper loss in 7.4.2 to 7.4.5 should be based on the approach given in the Appendix, which should include the effects of total power factor and total harmonic distortion of current in case of a non-linear load.

7.5 Motor Installation

7.5.1 Motor Efficiency

Preliminary Draft

A polyphase induction motor should have a nominal full-load motor efficiency fulfilling the corresponding value given in Table 7.5.1.

Table 7.5.1 : Minimum Nominal Full-Load Motor Efficiency for Single-Speed Polyphase Motor and Mult-Speed Polyphase Motor at High Speed	
Motor Rated Output (P, in kW)	Minimum Rated Efficiency (%)
1.1 kW \leq P < 1.5 kW	76.2 %
1.5 kW \leq P < 2.2 kW	78.5 %
2.2 kW \leq P < 3 kW	81 %
3 kW \leq P < 4 kW	82.6 %
4 kW \leq P < 5.5 kW	84.2 %
5.5 kW \leq P < 7.5 kW	85.7 %
7.5 kW \leq P < 11 kW	87 %
11 kW \leq P < 15 kW	88.4 %
15 kW \leq P < 18.5 kW	89.4 %
18.5 kW \leq P < 22 kW	90 %
22 kW \leq P < 30 kW	90.5 %
30 kW \leq P < 37 kW	91.4 %
37 kW \leq P < 45 kW	92 %
45 kW \leq P < 55 kW	92.5 %
55 kW \leq P < 75 kW	93 %
75 kW \leq P < 90 kW	93.6 %
P \geq 90 kW	93.9 %
Note: <ul style="list-style-type: none"> • Minimum efficiency levels based on standard of CEMEP Eff 2. • Compliance to above should be based on testing to relevant international standards such as IEEE 112-B:2004 or IEC 60034-2-1 (Ed.1.0). 	

7.5.2 Motor Sizing

For a motor above 5 kW output power rating, the ratio of its output power to the power demand of the system it drives should not exceed 125% of the anticipated system load unless the load characteristic requires a specially high starting torque. If the calculated 125% of system load does not fall in the rating of a standard rated motor, the next higher rating standard motor may be used.

7.5.3 Motor for Air-conditioning Equipment and Lift & Escalator

The requirements in clauses 7.5.1 and 7.5.2 do not apply to -

- (a) a motor of a chiller or unitary air-conditioner fulfilling the air-conditioning

Preliminary Draft

equipment efficiency requirement in clause 6.12; and

- (b) a motor of a lift and escalator installation fulfilling the electrical power requirement in clause 8.4.

7.6 Power Quality

7.6.1 Power Factor

7.6.1.1 The total power factor for a circuit at or above 400A (based on circuit protective device rating) or a circuit connecting to the meter of the electricity supplier at designed circuit current should not be less than 0.85. Design calculations are required to demonstrate adequate provision of power factor correction device to achieve the minimum power factor of 0.85.

7.6.1.2 In fulfilling 7.6.1.1 for a circuit with total power factor less than 0.85, a suitable power factor correction device, if provided, should be installed at the source motor control centre or local distribution board.

7.6.1.3 The requirement in clause 7.6.1.1 does not apply to a circuit serving a lift & escalator installation that has fulfilled the power factor requirement in clause 8.5.1.

7.6.2 Total Harmonic Distortion

7.6.2.1 The total harmonic distortion of current for a circuit connecting to the meter of the electricity supplier at designed circuit current should not exceed the corresponding figures in Table 7.6.2.

7.6.2.2 The total harmonic distortion of current for a circuit at or above 400A (based on circuit protective device rating) at designed circuit current should not exceed the corresponding figures in Table 7.6.2.

Table 7.6.2 : Maximum Total Harmonic Distortion of Current	
Designed Circuit Current (I, in A) at 380V/220V	Maximum Total Harmonic Distortion (THD) in Percentage of Fundamental Current
$I < 40A$	20.0 %
$40A \leq I < 400A$	15.0 %
$400A \leq I < 800A$	12.0 %
$800A \leq I < 2000A$	8.0 %

Preliminary Draft

$I \geq 2000A$	5.0 %
----------------	-------

- 7.6.2.3 In fulfilling 7.6.2.1 for a circuit with total harmonic distortion, a suitable harmonic reduction device should be provided at the source motor control centre or local distribution board.
- 7.6.2.4 In fulfilling 7.6.2.3 in respect of harmonic reduction device for a circuit principally for motors with variable speed drives, a group compensation at the motor control centre or local distribution board is allowed, provided that the maximum fifth harmonic current distortion at the VSD input terminals during normal operation within the variable speed range is less than 35%.
- 7.6.2.5 The requirement in clause 7.6.2.1 and 7.6.2.2 does not apply to a circuit serving a lift & escalator installation that has fulfilled the harmonics distortion requirement in clause 8.6.

7.6.3 Balancing of Single-phase Loads

For all three-phase 4-wire circuits exceeding 400A (based on circuit protective device rating) with single-phase loads, the maximum unbalanced single-phase loads distribution should not exceed 10% in terms of percentage unbalance.

7.7 Metering and Monitoring Facilities

7.7.1 Main Circuit

A main incoming circuit at or above 400A current rating (based on circuit protective device rating) should be incorporated with metering devices for measuring voltages (all phase-to-phase and phase-to-neutral), currents (all lines and neutral currents) and power factor, and for recording total energy consumption (kWh), maximum demand (kVA) and total harmonic distortion.

7.7.2 Feeder and Sub-main Circuit

- 7.7.2.1 A feeder or sub-main circuit exceeding 200A and below 400A current rating (based on circuit protective device), except for compensation of reactive and distortion power purpose, should be incorporated with metering devices, to measure currents (three phases and neutral) and record energy consumption in kWh for energy monitoring and audit purposes.

Preliminary Draft

- 7.7.2.2 A feeder or sub-main circuit at or above 400A current rating (based on circuit protective device rating), except for compensation of reactive and distortion power purpose, should be incorporated with metering devices for measuring voltages (all phase-to-phase and phase-to-neutral), currents (all lines and neutral currents) and power factor, and for recording total energy consumption (kWh), maximum demand (kVA) and total harmonic distortion.

Preliminary Draft

8. Energy Efficiency Requirements for Lift & Escalator Installations

8.1 Scope of Application

8.1.1 All lift & escalator installations, unless otherwise specified, in a specified building and premises should be in accordance with the energy efficiency requirements of this Section.

8.1.2 The following installations are not governed by the energy efficiency requirements of this Section –

- (c) mechanized vehicle parking system;
- (d) service lift, dumb-waiter, or stairlift;
- (e) industrial truck loaded freight lift;
- (f) lift in a performance stage;
- (g) powered lifting platform;
- (h) lift that is not operated on a traction drive by suspension ropes or not operated by a hydraulic piston; and
- (i) installation included in Schedule 4 of the Ordinance.

8.1.3 For the avoidance of doubt, the energy efficiency requirements of this Section should apply to -

- (a) all passenger lifts, bed passenger lifts, freight lifts, vehicle lifts, escalators and passenger conveyors; and
- (b) fireman's lifts that operate under non-fire condition.

8.2 General Approach

The requirements for energy efficient design of lift and escalator installations are for the purposes of –

- (a) reducing power consumption through imposing maximum allowable electrical power of motor drive;
- (b) reducing losses in the utilization of power through imposing minimum allowable total power factor, limiting the lift decoration load, and requiring a standby mode in lift operation;
- (c) reducing losses due to the associated power quality problems; and
- (d) providing appropriate metering and energy monitoring facilities for better energy efficiency management.

8.3 Definition of Terms

Preliminary Draft

The definitions of terms applicable to Lift & Escalator Installations are given in Section 2.

8.4 Electrical Power

8.4.1 Traction Lift

8.4.1.1 The running active electrical power of the motor drive of a traction lift system carrying a rated load at its rated speed in an upward direction should not exceed the maximum allowable value given in Table 8.4.1.

8.4.1.2 The requirement in clause 8.4.1.1 does not apply to –

- (a) a lift
 - i. with rated speed not less than 9 m/s serving a zone of over 50-storey or over 175m between top/bottom-most landing and principal/ground landing, and
 - ii. designated as fireman's lift or sky lobby shuttle serving two principal stops
- (b) a lift with rated load above 5000 kg at rated speed of 3 m/s or above.

Rated Load L (kg)	Rated Speed Vc (m/s)				
	Vc < 1	1 ≤ Vc < 1.5	1.5 ≤ Vc < 2	2 ≤ Vc < 2.5	2.5 ≤ Vc < 3
L < 750	6.7	9.5	11.4	15.2	17.1
750 ≤ L < 1000	9.5	11.4	16.2	20	22.8
1000 ≤ L < 1350	11.4	16.2	20.9	25.7	30.4
1350 ≤ L < 1600	14.3	19	25.7	30.4	36.1
1600 ≤ L < 2000	16.2	23.8	30.4	37.1	43.7
2000 ≤ L < 3000	23.8	35.2	44.7	56.1	66.5
3000 ≤ L < 4000	31.4	45.6	59.9	74.1	87.4
4000 ≤ L < 5000	39.9	57	74.1	92.2	109.3
L ≥ 5000	0.0079L + 0.475	0.0112L + 0.95	0.0148L + 0.48	0.018L + 1.9	0.0217L + 0.475

Preliminary Draft

	$3 \leq Vc < 3.5$	$3.5 \leq Vc < 4$	$4 \leq Vc < 5$	$5 \leq Vc < 6$	$6 \leq Vc < 7$
$L < 750$	20	21.9	23.8	28.5	32.3
$750 \leq L < 1000$	25.7	29.5	30.4	37.1	43.7
$1000 \leq L < 1350$	34.2	38	42.8	49.4	57
$1350 \leq L < 1600$	40.9	46.6	49.4	58.9	68.4
$1600 \leq L < 2000$	50.4	57	61.8	71.3	83.6
$2000 \leq L < 3000$	75.1	85.5	90.3	109.3	125.4
$3000 \leq L < 4000$	98.8	114	123.5	142.5	166.3
$4000 \leq L < 5000$	123.5	142.5	152	180.5	209
	$7 \leq Vc < 8$	$8 \leq Vc < 9$	$Vc \geq 9$		
$L < 750$	37.1	42.8	$4.643Vc + 0.0013Vc^3$		
$750 \leq L < 1000$	49.4	57	$6.192Vc + 0.002 Vc^3$		
$1000 \leq L < 1350$	66.5	76	$8.357Vc + 0.002Vc^3$		
$1350 \leq L < 1600$	78.9	90.3	$9.905Vc + 0.0025 Vc^3$		
$1600 \leq L < 2000$	99.8	114	$12.381Vc + 0.0013Vc^3$		
$2000 \leq L < 3000$	147.3	166.3	$18.572Vc + 0.0029Vc^3$		
$3000 \leq L < 4000$	194.8	223.3	$24.762Vc + 0.0036Vc^3$		
$4000 \leq L < 5000$	242.3	275.5	$30.953Vc + 0.0046Vc^3$		

8.4.2 Hydraulic Lift

The running active electrical power of the hydraulic oil pump motor of a hydraulic lift system carrying a rated load at its rated speed in an upward direction should not exceed the maximum allowable value given in Table 8.4.2.

Rated Load L (kg)	Power (kW)
$L < 1000$ kg	26.6
$1000 \text{ kg} \leq L < 2000$ kg	50.4
$2000 \text{ kg} \leq L < 3000$ kg	71.3
$3000 \text{ kg} \leq L < 4000$ kg	92.2
$4000 \text{ kg} \leq L < 5000$ kg	115
$L \geq 5000$ kg	$0.023L$

Preliminary Draft

8.4.3 Escalator

The running active electrical power of the steps driving motor of an escalator with nominal width W and rise R when operating under no-load condition at rated speed V_r should not exceed the corresponding maximum allowable value given in Table 8.4.3.

Table 8.4.3 : Maximum Electrical Power of Escalator at Designated Width and Rise for Various Ranges of Rated Speed Operating under No Load							
Nominal Width W (mm)	Rise R (m)	Electrical Power (W) at Rated Speed V_r (m/s)					
		Other Than Public Service Escalator			Public Service Escalator		
		$V_r < 0.5$	$0.5 \leq V_r < 0.6$	$0.6 \leq V_r < 0.75$	$V_r < 0.5$	$0.5 \leq V_r < 0.6$	$0.6 \leq V_r < 0.75$
600	$R < 3.5$	1283	1473	1853	Not Applicable		
	$3.5 \leq R < 5$	1520	1805	2233			
	$5 \leq R < 6.5$	1758	2138	2613			
	$R \geq 6.5$	$209R + 432$	$247R + 530$	$302R + 652$			
800	$R < 3.5$	1425	1615	1948	1995	2375	2945
	$3.5 \leq R < 5$	1710	1995	2423	2375	2850	3515
	$5 \leq R < 6.5$	1995	2375	2898	2755	3278	4085
	$6.5 \leq R < 8$	2328	2755	3373	3135	3705	4608
	$R \geq 8$	$230R + 588$	$253.6R + 694$	$312.5R + 853$	$291.6R + 795$	$347.7R + 952$	$433R + 1183$
1000	$R < 3.5$	1520	1805	2185	2138	2518	3135
	$3.5 \leq R < 5$	1900	2185	2708	2518	3230	3705
	$5 \leq R < 6.5$	2214	2660	3230	2898	3468	4275
	$6.5 \leq R < 8$	2613	3040	3753	3278	3895	4893
	$R \geq 8$	$268R + 653$	$349.6R + 771$	$346.7R + 997$	$305.6R + 837$	$346.7R + 1109$	$456.9R + 1251$

8.4.4 Passenger Conveyor

The running active electrical power of the steps driving motor of a passenger conveyor with length L and nominal width W at an inclination up to 6° from horizontal when operating under no-load condition at rated speed V_r should not exceed the corresponding maximum allowable value given in Table 8.4.4.

Preliminary Draft

Table 8.4.4 : Maximum Electrical Power of Passenger Conveyor at Designated Width and Length at Inclination up to 6° from Horizontal for Various Ranges of Rated Speed Operating under No Load									
Nominal Width (mm)	Nominal Length L (m)	Electrical Power (W) at Rated Speed Vr (m/s)							
		Other Than Public Service Passenger Conveyor				Public Service Passenger Conveyor			
		Vr < 0.5	0.5 ≤ Vr < 0.6	0.6 ≤ Vr < 0.75	0.75 ≤ Vr < 0.90	Vr < 0.5	0.5 ≤ Vr < 0.6	0.6 ≤ Vr < 0.75	0.75 ≤ Vr < 0.90
800	L < 8	1093	1450	1900	2138	1283	1663	1900	2233
	8 ≤ L < 12	1568	2100	2750	3088	1568	1995	2612	3088
	12 ≤ L < 16	2043	2750	3500	4085	2043	2613	3325	4085
	16 ≤ L < 20	2518	3900	4400	5035	2518	3705	4180	5035
	L ≥ 20	120.6L + 97	186L + 149	211L + 169	240L + 192	120.6L + 96	176.7L + 141	200.4L + 160	240.3L + 192
1000	L < 8	1235	1650	1900	2138	1378	1758	1995	2328
	8 ≤ L < 12	1995	2700	3050	3468	1995	2565	2898	3468
	12 ≤ L < 16	2660	3550	4000	4560	2660	3373	3800	4560
	16 ≤ L < 20	3278	4400	4950	5653	3278	4180	4703	5653
	L ≥ 20	155.8L + 124	209L + 168	237L + 190	270.7L + 216	155.8L + 124	198.5L + 159	225L + 180	270.7L + 216
1400 & above	L < 8	1544	2063	2375	2673	1723	2198	2494	2910
	8 ≤ L < 12	2494	3375	3813	4335	2494	3206	3623	4335
	12 ≤ L < 16	3325	4438	5000	5700	3325	4216	4750	5700
	16 ≤ L < 20	4098	5500	6188	7066	4098	5225	5879	7066
	L ≥ 20	195L + 155	261L + 210	296L + 238	338L + 270	195L + 155	248L + 199	281L + 225	338L + 270

Note: the maximum allowable electrical power for passenger conveyors with Nominal Width above 1000 mm and below 1400 mm is given by interpolation of the control figures for equipment at Nominal Width 1000 mm and equipment at Nominal Width 1400 mm, respectively at the corresponding Rated Speed and Nominal Length.

8.5 Utilization of Power

8.5.1 Total Power Factor

8.5.1.1 The total power factor of the motor drive of a lift at the isolator connecting the lift to the building's electrical supply circuit should not be less than 0.85 when the lift car is carrying a rated load at its rated speed and traveling in an upward direction.

8.5.1.2 The total power factor of the motor drive of an escalator or passenger conveyor at the

Preliminary Draft

isolator connecting the escalator or conveyor to the building's electrical supply circuit should not be less than 0.85 when the motor drive is operating under its brake load condition at rated speed, and for escalator or conveyor with a rise with the equipment moving in an upward direction.

8.5.1.3 For purpose of fulfilling clauses 8.5.1.1 or 8.5.1.2, a suitable power factor correction device can be installed at the motor control centre of the motor drive to provide the compensation to the corresponding level in clauses 8.5.1.1 or 8.5.1.2.

8.5.2 Lift Decoration Load

The maximum decoration load in a lift car should not be more than 50% of the lift's rated load with a limitation of 600kg.

8.5.3 Lift Standby Mode

8.5.3.1 Under normal operating status, at least one lift car of a lift bank should operate under a standby mode during low traffic period when the traffic demand on the vertical transportation system is low.

8.5.3.2 Under a standby mode of operation, a lift car should not respond to passenger calls until it returns to the normal operation mode.

8.5.3.3 For lift utilising DC M-G motor drive, the driving motor of the DC M-G motor drive system should be shut down during standby mode operation.

8.5.3.4 The ventilation of a lift car within a lift bank, during standby mode and upon idling for 2 minutes with the lift doors closed, should be shut off automatically until the lift car is activated again by passenger call.

8.6 Total Harmonic Distortion

8.6.1 When a lift car is moving up with rated load at its rated speed, the total harmonic distortion produced by the motor drive system at the isolator connecting the lift to the building's electrical supply circuit should be limited to the corresponding maximum allowable value given in Table 8.6.1.

Preliminary Draft

Table 8.6.1 : Maximum Total Harmonic Distortion of Motor Drive System for Lift	
Circuit Fundamental Current of Motor Drive, I (A), Moving Up with Rated Load at Rated Speed	Maximum Total Harmonic Distortion (%) in Each Phase
I < 40A	40%
40A ≤ I < 80A	35%
80A ≤ I < 400A	22.5%
400A ≤ I < 800A	15%

- 8.6.2 When an escalator or passenger conveyor is operating with no load at its rated speed, the total harmonic distortion produced by the motor drive system at the isolator connecting the escalator or passenger conveyor to the building's electrical supply circuit should be limited to the corresponding maximum allowable value given in Table 8.6.2.

Table 8.6.2 : Maximum Total Harmonic Distortion of Motor Drive System for Escalator and Passenger Conveyor		
Circuit Fundamental Current of Motor Drive, I (A), with No Load at Rated Speed	Maximum Total Harmonic Distortion (%) in Each Phase	
I < 40A	35, for electrical supply direct from building's feeder circuit	40, for electrical supply not direct from building's feeder circuit
40A ≤ I < 80A	35%	
80A ≤ I < 400A	22.5%	

- 8.6.3 For purpose of fulfilling clauses 8.6.1 or 8.6.2, a suitable harmonic reduction device can be installed at the motor control centre of the motor drive to reduce the overall total harmonic distortion to the corresponding level in clauses 8.6.1 or 8.6.2.

8.7 Metering and Monitoring Facilities

- 8.7.1 Metering devices or the provision for measurement should be provided for the electrical supply circuit for the motor drive of each lift, escalator or passenger conveyor, for measurement of voltages (phase-to-phase and phase-to-neutral), currents (line currents and neutral currents), total power factor, energy consumption (kWh), power (kW) and maximum demand (kVA).

- 8.7.2 In fulfilling clause 8.7.1 the provision for measurement should include the provision of suitable accessibility and sufficient space, with appropriate connecting ancillaries, for the

Preliminary Draft

ready connection and subsequent removal of such devices not entailing a stoppage or disruption to the operation of the lift, escalator or passenger conveyor.

*Preliminary Draft***9. Performance-based Approach****9.1 Scope of Application**

9.1.1 The requirements in this Section should be satisfied for buildings or premises using the performance-based approach, which is regarded as an alternative approach for meeting the prescriptive requirements given in Sections 5 to 8, in fulfilling the energy efficiency requirements under the Ordinance

9.2 General Approach

The requirements in the performance-based approach are for the purposes of -

- (a) reducing energy consumption in the designed building through the focus on its total energy consumption and the adoption of basic energy efficiency requirements; and
- (b) providing an alternative approach to full compliance with the energy efficiency requirements given in Sections 5 to 8.

9.3 Definitions

The definitions of terms applicable to Performance-based Approach are given in Section 2

9.4 Basic Requirements

9.4.1 Under the performance-based approach, the designed building is governed by the basic requirements given in Table 9.4.

Table 9.4 : Basic Requirements for Performance-based Approach

Energy efficiency requirements on building services installations:

Lighting installations, given in Section 5 (clause no.)

Lighting control (5.5)

Air-conditioning installations, given in Section 6 (clause no.)

System load calculation (6.4)

Separate air distribution systems for process requirements (6.5)

Air distribution ductwork leakage limit (6.6)

Pumping system variable flow (6.8)

Frictional loss of water piping system (6.9)

System control (6.10)

Preliminary Draft

<p>Insulation thickness (6.11)</p> <p>Energy meter (6.13)</p> <p><u>Electrical installations, given in Section 7 (clause no.)</u></p> <p>Power distribution loss (7.4)</p> <p>Motor installation (7.5)</p> <p>Power quality (7.6)</p> <p>Metering and monitoring facilities (7.7)</p> <p><u>Lift & escalator installations, given in Section 8 (clause no.)</u></p> <p>Electrical power (8.4)</p> <p>Utilization of power (8.5)</p> <p>Total harmonic distortion (8.6)</p> <p>Metering and monitoring facilities (8.7)</p>
Energy efficiency requirements on building envelope:
<u>Overall thermal transfer value, requirements same as given in Building (Energy Efficiency) Regulation Cap.123M</u>

9.4.2 The energy efficiency requirements given in Sections 5 to 8 not forming the basic requirements in Table 9.4 are deemed as the trade-off allowable requirements, by which the designed building is not governed.

9.5 Comparison of Design Energy and Energy Budget

9.5.1 A hypothetical design - the reference building, should be developed –

- (a) based on the designed building, in accordance with the procedure given in the Appendix, and
- (b) be governed by all the energy efficiency requirements given in Sections 5 to 8, irrespective of whether or not such are listed in Table 9.4.

9.5.2 The design energy and energy budget, respectively of the designed building and reference building, should be calculated -

- (a) using the same consistent numerical method for building energy analysis; and
- (b) in accordance with the procedure given in the Appendix.

9.5.3 The design energy should not exceed the energy budget.

9.5.4 Trade-off in Design Energy

9.5.4.1 In fulfilling clause 9.5.3, the increase in design energy as a result of not satisfying the trade-off allowable requirements in clause 9.4.2, can be off-set with reduction in design energy as a result of better performance than

Preliminary Draft

- (a) the level cited in any one or more of the energy efficiency requirements given in Sections 5 to 8, and/or
- (b) the overall thermal transfer value cited in the Building (Energy Efficiency) Regulation, Cap 123M, on condition that the energy reduction counted towards the off-set should be limited to not more than 5% of the energy budget.

9.5.4.2 The items or installations involved in the trade-off process should be under the same ownership.

9.6 Requirements in Major Retrofitting Works

9.6.1 The performance-based approach is applicable to major retrofitting works given in the Ordinance.

9.6.2 The trade-off of a lower energy performance of a component in the major retrofitting work using a better energy performance of components of an installation outside the major retrofitting work should be such that the scope and quantity of energy for trade-off is solely for the major retrofitting work in question, and for the purpose a written confirmation should be obtained from the owner of the installation.

Preliminary Draft

10. Energy Efficiency Requirements for Major Retrofitting Works

- 10.1 Whenever major retrofitting works are carried out in a specified building, the concerned works on building services installations, i.e. lighting, air-conditioning, electrical and lift & escalator installations should meet the energy efficiency requirements as stipulated in this Section.
- 10.2 The types of works which are classified as major retrofitting works are basically listed in Schedule 2 of the Ordinance and more detailed description of the works and the associated energy efficiency requirements applicable to them are given in Table 10.1.

Table 10.1 Major Retrofitting Works and Energy Efficiency Requirements				
Category of Major Retrofitting Work	Applicable Requirement	Clause No. in this Code	Condition for Applicability of Requirement	
(a) Addition or replacement works for lighting installation, electrical installation or air-conditioning installation covering a floor area aggregated to or greater than [500m ²] [under the same series of works], including - (multiple phases of works of the same nature completed according to a single works order or a series of works orders issued within 12 months under a planned work programme will be classified as under the same series of works)				
(i) addition or replacement of luminaires covering the area	lighting power density	5.4	sum of circuit wattage of additional or replacement luminaries at or exceeding [3kW]	no existing luminaires, or with sum of circuit wattage of additional or replacement luminaires more than that of 50% of the original luminaires in the area
	lighting control	5.5		complete new installation or no existing luminaires
(ii) addition or replacement of unitary air-conditioner(s) serving the area	air- conditioning equipment efficiency	6.12	sum of cooling/ heating capacity of additional or replacement air- conditioners at or exceeding [60kW]	Nil
	frictional loss of piping	6.9	involving water pipework for the additional equipment, or complete replacement of corresponding water side pumping system	involving water pipework for the additional equipment, or complete replacement of corresponding water side pumping system
	insulation thickness	6.11		involving corresponding additional or replacement pipework or ductwork
	efficiency of motor	7.5		involving additional or replacement water pump
(iii) addition or replacement of air	separate air distribution system for process requirement	6.5	sum of cooling/ heating capacity of	additional or replacement air handling unit(s) forming a complete air distribution system in the

Preliminary Draft

Table 10.1 Major Retrofitting Works and Energy Efficiency Requirements				
Category of Major Retrofitting Work	Applicable Requirement	Clause No. in this Code	Condition for Applicability of Requirement	
handling unit(s) serving the area	air distribution system fan power	6.7	additional or replacement	context of clause 6.7
	frictional loss of piping	6.9	air handling units at or exceeding [60kW]	involving water pipework for the additional equipment, or complete replacement of corresponding water side pumping system
	insulation thickness	6.11		involving corresponding additional or replacement pipework, ductwork or casing
	efficiency of motor	7.5		involving additional or replacement water pump, air handling unit or fan
(b) Addition or replacement of unitary air-conditioner or chiller of a cooling/heating rating at or exceeding [350kW]	air- conditioning equipment efficiency	6.12	nil	
	pumping system variable flow	6.8	involving for the additional or replacement air-conditioning equipment the addition or complete replacement of corresponding water side pumping system, and with independent system operation	
	frictional loss of piping	6.9	involving water pipework for the additional equipment, or complete replacement of corresponding water side pumping system	
	insulation thickness	6.11	involving corresponding additional or replacement pipework, ductwork or casing	
	energy meter	6.13	nil	
	efficiency of motor	7.5	involving additional or replacement water pump, air handling unit or fan	
(c) Addition or replacement of complete electrical circuit at rating [400A three-phase or above]	circuit copper loss	7.4	work involving a complete feeder, sub-main or final circuit	
	circuit total power factor	7.6.1	work involving the main LV switchboard	
	circuit total harmonic distortion	7.6.2		
	final circuit single phase load balancing	7.6.3	work involving complete final circuit	
	metering & monitoring	7.7	work involving additional switch cubicle in LV switchboard	

Preliminary Draft

Category of Major Retrofitting Work	Applicable Requirement	Clause No. in this Code	Condition for Applicability of Requirement
(d) Addition or replacement of motor drive and mechanical drive of a lift, escalator or passenger conveyor	electrical power for traction lift	8.4	involving lift with machine above and with 1:1 or 2:1 suspension roping system
	electrical power for hydraulic lift, escalator and passenger conveyor	8.4	nil
	total power factor	8.5.1	
	lift standby mode	8.5.3	
	total harmonic distortion	8.6	
	metering & monitoring	8.7	
	lift decoration load	8.5.2	involving addition of lift car

Preliminary Draft

11. Requirements on Maintenance

- 11.1 The requirements in the Ordinance for the purpose of renewal of the Certificate of Compliance Registration will be deemed to be satisfied if the following minimum maintenance requirements are followed -
- 11.1.1 The energy efficiency standard of the central building services installation of a building covered by the Certificate of Compliance Registration should be maintained to a standard not lower than the corresponding Code standard adopted in the Certificate of Compliance Registration;
- 11.1.2 For the part of altered or replaced installations, if any, which are covered by a Form of Compliance under the scope of major retrofitting works, such part of installations should be maintained to a standard not lower than the corresponding Code standard adopted in the Form of Compliance;
- 11.1.3 Minor alteration or replacement of the installations, if any, which are not covered by any Form of Compliance under the scope of major retrofitting works, carried out subsequent to the issuance of the Certificate of Compliance Registration should not lower the energy efficiency performance of the installation to a standard stipulated in the Code applicable to the original installations before such alteration or replacement works are carried out;
- 11.1.4 As-built records of the installations, including their subsequent alterations, should be maintained according to the good trade practice to facilitate inspections;
- 11.1.5 Records on energy consumptions or from which energy consumptions could be derived, obtained through metering facilities required in the Code, should be kept for regular review of the energy performance of the installations.
- 11.1.6 Operation and maintenance documents such as manufacturers' maintenance manuals of the installations should be kept to facilitate planning of maintenance; and
- 11.1.7 Proper operation and maintenance logs should be kept for regular review of the operating performance of the installations.
- 11.2 While good engineering and trade practices should be adopted in maintenance of the energy efficiency performance of the installations, due consideration would be allowed for normal wear and tear for degrading of energy efficiency performance of the installations over time gradually, provided that the design standard of such installations

Preliminary Draft

has not been lowered in any alteration or replacement works.

Preliminary Draft

Appendix 1

Guidelines on Calculation of Cable Loss

This appendix provides a guidance on the calculation of copper losses in circuits for fulfilling Section 7 of the Code.

A1 Resistance of Copper Cable

A1.1 Table A1 below provides resistance values of copper cables, which can be based upon in the selection of appropriate cable sizes for fulfilling the requirements on allowable percentage copper loss in an electrical circuit.

Table A1 : Conductor (copper) Resistance for PVC and XLPE Cable at 50 Hz Single-phase or Three-phase a.c.						
Conductor cross- sectional area (mm ²)	Conductor Resistance (mΩ/m)					
	Multicore Armoured & Non-armoured #1		Single-core PVC/XLPE Non-armoured, with or without sheath #2			
	PVC cable at max. conductor operating temperature of 70°C	XLPE cable at max. conductor operating temperature of 90°C	PVC cable at max. conductor operating temperature of 70°C		XLPE cable at max. conductor operating temperature of 90°C	
			Enclosed in conduit/ trunking	Clipped direct or on tray, touching	Enclosed in conduit/ trunking	Clipped direct or on tray, touching
1.5	14.5	15.5	14.5	14.5	15.5	15.5
2.5	9	9.5	9	9	9.5	9.5
4	5.5	6	5.5	5.5	6	6
6	3.65	3.95	3.65	3.65	3.95	3.95
10	2.2	2.35	2.2	2.2	2.35	2.35
16	1.4	1.45	1.4	1.4	1.45	1.45
25	0.875	0.925	0.9	0.875	0.925	0.925
35	0.625	0.675	0.65	0.625	0.675	0.675
50	0.465	0.495	0.475	0.465	0.5	0.495
70	0.315	0.335	0.325	0.315	0.35	0.34
95	0.235	0.25	0.245	0.235	0.255	0.245
120	0.19	0.2	0.195	0.185	0.205	0.195
150	0.15	0.16	0.155	0.15	0.165	0.16
185	0.125	0.13	0.125	0.12	0.135	0.13
240	0.095	0.1	0.0975	0.0925	0.105	0.1
300	0.0775	0.08	0.08	0.075	0.0875	0.08
400	0.0575	0.065	0.065	0.06	0.07	0.065
500	-	-	0.055	0.049	0.06	0.0525
630	-	-	0.047	0.0405	0.05	0.043
800	-	-	-	0.034	--	0.036
1000	-	-	-	0.0295	-	0.0315

#1 Based on Table 4D2B, 4D4B, 4E2B & 4E4B, BS7671, The Regulations for Electrical Installations
#2 Based on Table 4D1B & 4E1B, BS7671

*Preliminary Draft***A2 Cable Sizing**

The relationship among circuit design current I_b , nominal rating of protective device I_n and effective current-carrying capacity of conductor I_z for an electrical circuit can be expressed as:

$$I_b \leq I_n \leq I_z$$

A2.1 Conventional Method

Assumption: The supply voltages and load currents are sinusoidal and balanced among the three phases in a three-phase 4-wire power distribution system.

Calculated minimum tabulated value of current: $I_{t(\min)} = I_n \times \frac{1}{C_a} \times \frac{1}{C_g} \times \frac{1}{C_i}$

Effective current-carrying capacity : $I_z = I_t \times C_a \times C_g \times C_i$

Where I_t = the value of current tabulated in Appendix 4 of BS7671

C_a = Correction factor for ambient temperature

C_g = Correction factor for grouping

C_i = Correction factor for thermal insulation

A2.2 Accounting for Power Factor and Losses due to Harmonic Distortion in Circuits with Non-linear LoadsDisplacement Power Factor & Total Power Factor

Consider a circuit with non-linear load current I , which is the r.m.s. value of fundamental I_1 and all harmonic components I_2, I_3, I_4, \dots , an expression of the power factor can be given as follows:

Assumption: The circuit is fed from a line voltage U having a low value of distortion and only the fundamental sinusoidal value U_1 is significant:

$$\begin{aligned} \text{Apparent Power: } S &= UI \\ S^2 &= (UI)^2 = U_1^2(I_1^2 + I_2^2 + I_3^2 + I_4^2 + \dots) \\ &= U_1^2 I_1^2 \cos^2 \theta + U_1^2 I_1^2 \sin^2 \theta + U_1^2 (I_2^2 + I_3^2 + I_4^2 + \dots) \end{aligned}$$

According to this expression in the distorted circuit, the apparent power contains three major components:

$$(1) \text{ Active Power in kW : } P = U_1 I_1 \cos \theta$$

Preliminary Draft

(This is the effective useful power)

(2) Reactive Power in kVAr : $Q = U_1 I_1 \sin\theta$

(This is the fluctuating power due to the fundamental component and coincides with the conventional concept of reactive power in an inductive circuit consumed and returned to the network during the creation of magnetic fields)

(3) Distortion Power in kVAd $D^2 = U_1^2 \cdot (I_2^2 + I_3^2 + I_4^2 + \dots)$

$D = U_1 \sqrt{(I_2^2 + I_3^2 + I_4^2 + \dots)}$ (This power appears only in distorted circuits and its physical meaning is that of a fluctuating power due to the presence of harmonic currents)

The relationship among these three power components can be shown in the following power triangles in Figure A2 :

(1) Fundamental Components : $S_1^2 = P^2 + Q_1^2$

with Displacement Power Factor $\cos\theta = P/S_1$

(2) Fluctuating Power : $Q_T^2 = Q_1^2 + D^2$

(3) Power Triangle in Distorted Circuit : $S^2 = Q_T^2 + P^2$

with Total Power Factor $\cos\gamma = P/S$, which is always smaller than the Displacement Power Factor $\cos\theta$, and can be improved by either reducing the amount of harmonic distortion power (kVAd) or reactive power (kVAr)

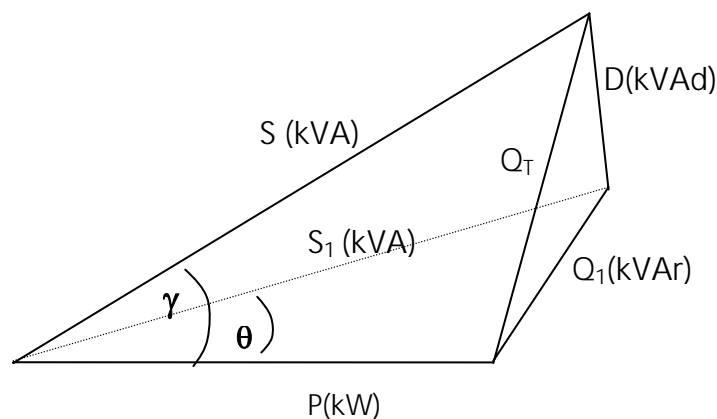


Fig. A2 - Power Triangles for Apparent Power, Active Power, Reactive Power & Distortion Power

*Preliminary Draft***A3 Copper Loss Calculation****A3.1 For a Three-phase Balanced and Linear Circuit:**

Apparent power transmitted along the circuit conductors in VA, $S = \sqrt{3}U_L I_b$

Active power transmitted along the circuit conductors in W, $P = \sqrt{3}U_L I_b \cos\theta$

Total copper losses in conductors in W, $P_{\text{copper}} = 3 \times I_1^2 \times r \times L$

where U_L = Line to line voltage, 380V

$I_b = I_1$ = Design current (with no distortion) of the circuit in ampere

$\cos\theta$ = Power factor of the circuit

r = a.c. resistance per metre at the conductor operating temperature

L = Length of the cable in metre

Percentage copper loss with respect to the total active power transmitted,

$$\% \text{ loss} = \frac{3 \times I_1^2 \times r \times L}{\sqrt{3}U_L I_1 \cos\theta}$$

$$\text{Therefore, max. } r \text{ (m}\Omega\text{/m)} = \frac{\text{max. \% loss} \times U_L \times \cos\theta \times 1000}{\sqrt{3} \times I_1 \times L}$$

Appropriate conductor size can then be selected from Table A1 based on calculated value of r .

Correction for copper loss calculation due to various conductor operating temperature can be carried out as follows:

Conductor operating temperature at design current I_b , which = I_1 , is given by:

$$t_1 = t_a + \frac{I_1^2}{I_t^2} (t_p - 30)$$

where t_a = actual or expected ambient temperature

t_p = maximum permitted conductor operating temperature

ambient temperature = 30°C

The resistance of a copper conductor R_t at temperature t_1 is given by:

$$R_t = R_{20} [1 + \alpha_{20} (t_1 - 20)]$$

Preliminary Draft

where R_{20} = conductor resistance at 20°C
 α_{20} = temperature coefficient of resistance of copper at 20°C
 (0.00393/°C)

or alternatively,

$$R_t = R_0(1 + \alpha_0 t_1)$$

where R_0 = conductor resistance at 0°C
 α_0 = temperature coefficient of resistance of copper at 0°C
 (0.00428/°C)

$$\text{Therefore ratio, } \frac{R_t}{R_p} = \frac{1 + \alpha_0 t_1}{1 + \alpha_0 t_p} \approx \frac{230 + t_1}{230 + t_p}$$

A3.2 For a Three-phase Balanced Non-Linear Circuit Having Known Harmonic Current:

Apparent power transmitted along the circuit conductors in VA,

$$S = \sqrt{3}U_L I_b$$

$$\text{where } I_b = \sqrt{\sum_{h=1}^{\infty} I_h^2} = \sqrt{I_1^2 + I_2^2 + I_3^2 + \dots}$$

$$\text{From definition: THD} = \frac{\sqrt{\sum_{h=2}^{\infty} (I_h)^2}}{I_1}$$

$$\text{Therefore, } I_b = I_1 \sqrt{1 + \text{THD}^2}$$

$$\text{And, the fundamental current } I_1 = \frac{I_b}{\sqrt{1 + \text{THD}^2}}$$

Assuming voltage distortion is small, $U_L = U_1$, and active power transmitted along the circuit conductors in W is given by:

$$P = \sqrt{3}U_L I_1 \cos\theta$$

where U_L = Supply line voltage at 380V

I_1 = Fundamental phase current of the circuit in ampere

$\cos\theta$ = Displacement power factor of the circuit

$$\text{And, Total Power Factor} = \frac{P}{S} = \frac{\cos\theta}{\sqrt{1 + \text{THD}^2}}$$

Preliminary Draft

Assuming the skin and proximity effects are small, total copper losses in conductors including neutral in W is given by:

$$P_{\text{copper}} = (3 \times I_b^2 + I_N^2) \times r \times L$$

where I_N = Neutral current of the circuit in ampere

$$= 3 \times \sqrt{I_3^2 + I_6^2 + I_9^2 + \dots}$$

I_b = Design r.m.s. phase current of the circuit in ampere

r = a.c. resistance per metre at the conductor operating temperature

L = Length of the cable in metre

Percentage copper loss with respect to the total active power transmitted,

$$\% \text{ loss} = \frac{(3 \times I_b^2 + I_N^2) \times r \times L}{\sqrt{3} U_L I_1 \cos \theta}$$

$$\text{Therefore, max. } r \text{ (m}\Omega\text{/m)} = \frac{\text{max. \% loss} \times \sqrt{3} \times U_L \times I_1 \times \cos \theta \times 1000}{(3 \times I_b^2 + I_N^2) \times L}$$

Appropriate conductor size can then be selected from Table A1 based on calculated value of r .

Correction for copper loss calculation due to various conductor operating temperature can be carried out as follows:

Conductor operating temperature at phase current I_b & neutral current I_N is given by:

$$t_1 = t_a + \frac{(3I_b + I_N)^2}{(3I_t)^2} (t_p - 30)$$

where t_a = actual or expected ambient temperature

t_p = maximum permitted conductor operating temperature

The resistance of a copper conductor R_t at temperature t_1 is given by:

$$R_t = R_0 (1 + \alpha_0 t_1)$$

where R_0 = conductor resistance at 0°C

α_0 = temperature coefficient of resistance of copper at 0°C
(0.00428/°C)

$$\text{Therefore ratio, } \frac{R_t}{R_p} = \frac{1 + \alpha_0 t_1}{1 + \alpha_0 t_p} \approx \frac{230 + t_1}{230 + t_p}$$

*Preliminary Draft***A3.3 For a Circuit Consisting of Different Components**

A circuit such as feeder or sub-circuit may consist of two or more component sections. The percentage copper loss in each component section should be calculated and added up to arrive at the overall percentage copper loss.

Consider a sub-circuit consisting of a riser serving 10 nos. floors with tee-off on each floor and a lateral tee-off on 10/F to a local distribution board. The overall percentage copper loss is given by:

$$cl_m / tap_m + cl_{1r} / tap_{1r} + cl_{2r} / tap_{2r} + \dots + cl_{10r} / tap_{10r} + cl_t / tap_t$$

(summing up for all portions of the rising mains)

- where
- cl : copper loss
 - tap : total active power
 - m : portion of sub-circuit from LV main switch on G/F to rising main
 - 1r : 1/F portion of riser from G/F to 1/F
 - 2r : 2/F portion of riser from 1/F to 2/F
 - : :
 - 10r : 10/F portion of riser from 9/F to 10/F
 - t : portion of sub-circuit tee-off from riser to local distribution board
(in case of a feeder the portion of tee-off to the current-using equipment)

Preliminary Draft**Appendix 2****Calculation of total energy consumption in a building or premises using numerical method for building energy analysis**

[Remark: Reinforcement of conceptual requirement to input actual data in energy simulation and adjustments to Tables A1 and A2 being finalized.]

A1 Introduction

A1.1 The calculation of total energy consumption in a building or premises is based on a numerical method for building energy analysis. The purpose of the calculation is to develop fair and consistent evaluations of the energy performance of the effects of deviations from the energy efficiency requirements given in Sections 5 to 8 that can be collectively regarded as the prescriptive requirements. Simplifying assumptions if adopted should be aimed to rationalize the modeling or simulation without compromising the intent of energy efficiency.

A1.2 Information of the building design should be translated into building description data required for the energy calculation and simulation. The designed building should be represented in the energy calculation tool using the format required for the building energy analysis and simulation process.

A1.3 The reference building should be developed by modifying the description of the designed building, which should have all the features of the designed building, but be modified to meet all the prescriptive requirements in Sections 5 to 8.

A1.4 Definition of Terms

'building envelope': is the ensemble of the building's external walls as defined under Building Regulations.

'conditioned floor area': is the floor area of conditioned space, as measured at the floor level within the interior surfaces of walls enclosing the conditioned space.

'conditioned space': has the meaning in Section 5.

'design documents': means the documents for describing the building design or building system design, such as drawings and specifications.

'lighting power': means the electrical power consumed by lighting installations of an illuminated space.

'modelling assumptions': are the conditions (such as weather conditions, thermostat settings and schedules, internal heat gain, operation schedules, etc.) that are used for calculating a building's annual energy consumption in this Code.

'non-renewable energy': means energy derived from non-renewable energy sources such as coal, oil and natural gas.

'OTTV Code': means Code of Practice for Overall Thermal Transfer Value in Buildings, Cap. 123M and the subsequent amendment.

Preliminary Draft

'overall thermal transfer value' (OTTV) (unit: W/m^2): means the overall thermal transfer value defined and specified in the OTTV Code.

'recovered energy': means waste energy recovered at the building site that is used to offset consumption of purchased fuel or electrical energy supplies.

'renewable energy': means thermal, chemical, or electrical energy derived from direct conversion of incident solar radiation or other renewable energy sources at the building site and used to offset consumption of purchased fuel or electrical energy supplies. For the purposes of applying this Code, renewable energy should not include passive heat gain through fenestration systems.

'space conditioning system': is a system that provides either collectively or individually cooling, heating, or ventilating within or associated with conditioned spaces in a building.

'shading coefficient (SC)': is the ratio of solar heat gain at normal incidence through glazing to that through 3 mm thick clear, double-strength glass. Shading coefficient, as used herein, does not include interior, exterior, or integral shading devices.

'skylight-roof ratio': is the ratio of skylight area to gross roof area.

'thermal block': means a collection of one or more HVAC zones grouped together for simulation purposes. Spaces need not be contiguous to be combined within a single thermal block.

'unconditioned space': is the enclosed space within a building that is not directly conditioned.

'window-wall ratio': is the ratio of vertical fenestration area to gross exterior wall area.

A1.5 Abbreviations and Acronyms

kWh	kilowatt hour
L/s/psn	litre per second per person
MWh	megawatt hour
W/m^2	Watt per square metre
$W/m^2\text{-}^\circ C$	Watt per square metre-degree Celcius

A2 Numerical Method for Building Energy Analysis

A2.1 The numerical method for the building energy analysis should be designed for the estimation of energy consumption in buildings in a comprehensive manner and should include calculation methodologies for the building components or systems being considered.

A2.2 The use of an hour-by-hour, full-year, multiple-zone numerical analysis for modelling and simulating the design energy and energy budget is required. Simpler tools are allowed if they have been shown to produce equivalent results for the type of building and relevant building features and/or systems being considered.

A2.3 The simulation program should use scientifically justifiable techniques and procedures for modelling building loads, systems, and equipment. It should simulate or model the thermal behaviour of buildings and the interaction of their building fabric, air-conditioning, lighting and

Preliminary Draft

other relevant energy consuming equipment.

A2.4 The simulation program to be used should have the ability to either directly determine the design energy and energy budget, or produce simulation reports of energy use suitable for determining the design energy and energy budget using a separate calculation engine.

A2.5 The simulation program should be capable of performing design load calculations to determine required air-conditioning equipment capacities and air and water flow rates for both the designed building and reference building.

A2.6 When a simulation program is used to verify compliance with the Code via the performance-based approach in Section 9, essential information about its modelling capabilities, calculation techniques and validation results should be provided for evaluation and approval by EMSD.

A3 Evaluation of Building Energy Performance

A3.1 General Requirements

A3.1.1 **Trade-Offs Limited to Compliance Areas.** When compliance applies to a portion of a building, only the calculation parameters related to the systems for the areas concerned should be allowed to vary. Parameters in relation to unmodified existing conditions or to future building components should be identical for both the energy budget and the design energy calculations.

A3.1.2 **Climatic Data.** Weather data used with the simulation program must be appropriate for the complexity of design features. The climatic data used in the energy analysis should cover a full calendar year of 8,760 hours and should reflect coincident hourly data for temperature, solar radiation, humidity and wind speed based on data from the Hong Kong Observatory. The weather data should be fully verified and justified. The same weather data must be used for the calculation of the designed building and reference building. Weather data of Test Reference Year or weather data in the format of Typical Meteorological Year should preferably be used in the energy calculation.

A3.1.3 **Operating Schedule.** Building operation should be simulated for a full calendar year. Operating schedules should include hourly profiles for daily operation and should account for variation between weekdays, weekends, holidays, and any seasonal operation, where applicable. The schedules should model the time-dependent variations of occupancy, lighting, equipment loads, thermostat settings, mechanical ventilation, air-conditioning equipment availability, and any process loads.

A3.1.4 **Occupant-sensitive Features.** Occupant behaviour should not be relied upon to achieve consistent and permanent reductions in building energy consumption. Design features that depend on the co-operation of the occupants such as the use of blinds should be excluded from the energy calculation.

A3.1.5 **Renewable Energy.** Useful energy generated from renewable energy sources or recovered from suitable sources can be considered in the evaluation of building energy performance, provided that the sources are reliable and appropriate method is used to estimate the energy generation. To provide credit for these sources in the Code compliance, renewable

Preliminary Draft

energy or recovered energy for routine duty can be excluded from the design energy allowed for the building. Where renewable energy or recovered energy are used, the reference building design should be based on the energy source used as the back-up energy source or electricity if no backup energy source has been specified.

A3.1.6 Professional Judgement. Although certain modelling techniques and compliance assumptions applied to the designed building are fixed or restricted, there are other aspects of computer modelling for which professional judgement is necessary. In those instances, it must be exercised properly in evaluating whether a given assumption is appropriate. EMSD has full discretion to accept or not a particular input, especially if the user has not substantiated the value with supporting evidence and documentation.

A3.1.7 Exclusions. The energy calculation can exclude such consumptions/loadings for installations exempted from the compliance of the Ordinance, such as fire services, and essential health and safety-related installations.

A3.2 Determination of Design Energy for the Designed Building

A3.2.1 Simulation Model. The simulation model of the designed building should be consistent with the design documents, including proper accounting of window and wall types and area; lighting power and controls; air-conditioning system types, sizes, and controls; and so on. The major building systems including building envelope, lighting and air-conditioning must be included in the energy calculation. Other building systems are often excluded or kept constant in the building energy simulation. But on an exceptional situation (A3.4 below), these systems may be included in the energy analysis, provided that an appropriate calculation method is proposed and demonstrated to the satisfaction of EMSD.

A3.2.2 System Capacities and Data. When air-conditioning, lighting and other appropriate building systems and equipment are included in the energy calculation, they should be simulated for the designed building using capacities, rated efficiencies, and part-load performance data for the proposed equipment as provided by the equipment manufacturer. If a system or equipment has not been completely determined and specified, its information should be based on reasonable assumptions of the design or construction of such system or equipment. These assumptions should be based on appropriate professional judgement and all of them should be documented so that these systems and equipment can be subject to verification.

A3.2.3 Yet-to-be-designed Features. When the method is applied to buildings in which energy-related features have not yet been designed, those yet-to-be-designed features should be described in the designed building so that they minimally comply with applicable requirements of Sections 5 to 8. Where the space classification for a portion of the building is not known, the portion should be assumed a reasonable occupancy appropriate to the building project. All the assumptions should be documented and subject to verification.

A3.2.4 Building Envelope. All components of the building envelope in the designed building should be modelled as shown on architectural drawings or as installed for existing building envelopes. If necessary, reference should also be made to the approved plans in the relevant submission for the OTTV Code.

Preliminary Draft

A3.2.5 **Lighting.** Lighting power in the design should be determined as follows:

- (a) Where a complete lighting system exists, the actual lighting power should be used in the model.
- (b) Where a lighting system has been designed, lighting power should be determined in accordance with the design.
- (c) Where no lighting system has been specified but it is expected, lighting power should be determined in accordance with building and space type categories given in clause A3.5.

A3.2.6 **Air-conditioning** The air-conditioning system type and all related performance parameters in the proposed design should be determined as follows:

- (a) Where a complete air-conditioning system exists, the model should reflect the actual system type using actual component capacities and efficiencies.
- (b) Where an air-conditioning system has been designed, the air-conditioning model should be consistent with the design. Some simulation software might require the efficiencies of mechanical equipment to be adjusted from actual design conditions to the standard rating conditions.
- (c) Where no cooling system has been specified but it is expected, the cooling system should be modelled as a simple air-cooled single-zone system, one unit per thermal block. The system characteristics should be identical to the system modelled in the reference building.
- (d) Where no heating system has been specified but it is expected, the heating system should be modelled as electric. The system characteristics should be identical to the system modelled in the reference building.

A3.2.7 **Lift and Escalator.** Good energy efficient practices of lift and escalator design are specified in the basic requirements and normally no trade-off should be allowed. Under an exceptional situation in clause A3.4, lift and escalator systems may be included in the energy analysis, provided that an appropriate calculation method is proposed and verified.

A3.2.8 **Other Systems.** Other building systems may be modelled using exceptional calculation methods (3.4 below). If they are modelled, performance should be as indicated on design documents. Miscellaneous internal loads, such as those due to office and other equipment, should be estimated based on the building and space type categories in clause A3.5.

A3.2.9 **Exclusion of Building Components and Systems.** To simplify the calculation procedures, some building components and systems in the proposed design may be excluded from the simulation model provided that:

- (a) the component energy usage does not affect the energy usage of systems and components that are considered for trade-off; or
- (b) the excluded components can meet the relevant requirements of Sections 5 to 8.

A3.2.10 **Alterations and Additions.** For a design relating to major retro-fitting of an existing building, on the building itself or its building services, it is acceptable to demonstrate compliance using building models that exclude parts of the existing building provided all of the following conditions are met:

- (a) Work to be performed in the excluded parts of the building should meet the requirements of Sections 5 to 8.
- (b) The excluded parts of the building are served by air-conditioning systems that are

Preliminary Draft

entirely separate from those which are included in the building model.

- (c) Design space temperature and air-conditioning system operating set points and schedules, on either side of the boundary between included and excluded parts of the building, are identical.

A3.2.11 *Limitations to the Simulation Program.* If the simulation program cannot model a component or system included in the designed building, one of the following methods should be used subject to the approval of EMSD:

- (a) Ignore the component or system if the impact on the trade-offs being considered is not significant.
- (b) Model the component or system by substituting a thermodynamically similar component or system model.
- (c) Model the component or system using the same component or system of the reference building.

Whichever method is selected, the component should be modelled identically for both the designed building and reference building.

A3.3 Determination of Energy Budget for the Reference Building

A3.3.1 *Simulation Model.* The simulation model of the reference building should be developed by modifying the model of the designed building as described in clause A3.2. Except as specifically instructed in A3.2 and in this clause, all appropriate building systems and equipment should be modelled identically for both the reference building and designed building.

A3.3.2 *Building Envelope.* The reference building should have identical conditioned floor area and identical exterior dimensions and orientations as the designed building, except as noted in (a), (b), and (c) in this clause. For existing building envelopes, the reference building should reflect existing conditions prior to any revisions. For new building envelopes, the envelope model of the reference building should be modified from that used in the designed building as follows:

- (a) Opaque assemblies such as roof, floors, doors, and walls should be modelled as having the same heat capacity as the designed building (non-trade-off).
- (b) All roof surfaces should be modelled with a solar absorptivity of 0.7 (non-trade-off).
- (c) No shading projections are to be modelled; fenestration should be assumed to be flush with the exterior wall or roof.

A3.3.3 *OTTV.* The building envelope (including all external walls and roofs) of the reference building should satisfy the requirements in the OTTV Code. To determine the appropriate envelope parameters for the reference building, the designer should adjust from the envelope model of the designed building the combinations of the window-wall ratio and skylight-roof ratio, and the shading coefficients of windows and skylights so as to meet the OTTV requirements.

A3.3.4 *Lighting.* Regarding lighting power density of the reference building, reference should be made to the category determined for the designed building, that is building type or space type. Then, identify for each space a corresponding type of space in clause A3.5, and use the corresponding maximum allowable lighting power density values for the spaces of the reference building. Lighting controls should be the minimum required in Section 5.

Preliminary Draft

A3.3.5 *Air-conditioning.* The air-conditioning system and equipment type of the reference building should be the same as the designed building, but the system and equipment of the reference building should exactly meet the relevant requirements in Section 6.

A3.3.6 *Lift and Escalator.* Lift and escalator systems are usually excluded in the building energy simulation, and under such circumstance if they are considered in the energy analysis, the related systems or components should be the same as those of the designed building. Should a trade-off of lift or escalator energy consumption between the designed building and the reference building be adopted, the procedure in clause A3.4 should apply.

A3.3.7 *Other Systems.* Other systems and miscellaneous loads, if they are considered, should be modelled as identical to those in the designed building. Where there are specific efficiency requirements in Sections 5 to 8, these systems or components should be modelled as having the lowest efficiency allowed by those requirements.

A3.4 Exceptional Calculation Methods

A3.4.1 Where no simulation program is available to adequately models a design, material, or device, EMSD may approve an exceptional calculation method to be used to demonstrate compliance. An application for approval of an exceptional method should be made. The criteria for acceptance of exceptional calculation methods are not easy to define and EMSD will consider the specific case based on professional judgement and will provide a reasonable assessment.

A3.4.2 For approval of an exceptional method, theoretical and empirical information verifying the method's accuracy should be submitted, which should include the following documentations to demonstrate that the exceptional calculation method and results:

- (a) make no change in any input parameter values specified in Section 9 and this Appendix;
- (b) provide input and output documentation that facilitates EMSD's review and meets the formatting and content required by EMSD; and
- (c) are supported by clear and concise instructions for using the method to demonstrate that the energy budget requirement is met;
- (d) are reliable and accurate relative to the appropriate computer program; and
- (e) establishes factors that, when applied to the method's outputs, result in energy budgets that are equivalent to those in this Appendix.

A3.4.3 When an exceptional method is proposed and used, a detailed evaluation report of the energy consumption of the designed building and the building's materials, components, and manufactured devices proposed to be installed to meet the requirements of Section 9 and this Appendix should be provided. The evaluation should include a copy of the technique, instructions for its use, a list of all input data, and all other information required to replicate the results.

A3.5 Modelling Assumptions and Methods

A3.5.1 The detailed information described here are the modelling assumptions and methods for calculating the design energy of the designed building and the energy budget of the

Preliminary Draft

reference building. In order to maintain consistency between the two sets of calculations, the input assumptions in this Appendix should be used.

A3.5.2 'Prescribed' assumptions should be used without variation. 'Default' assumptions should be used unless the designer can demonstrate that a different assumption better characterizes the building's use over its expected life. Any modification of a default assumption should be used in modelling both the reference building and the designed building unless the designer demonstrates a clear cause to do otherwise.

A3.5.3 Orientations and Shape

General Building Design (prescribed assumption). The reference building should consist of the same number of stories and gross floor area for each story as the designed building. Each floor should be oriented exactly as the designed building. The geometric form should be the same as the designed building. The orientation should be the same as the designed building.

A3.5.4 Space Use

All 'air-conditioned' thermal blocks or spaces should be classified as either building type (all spaces having the same function) or space type (spaces having different functions), and a space should be assigned a type selected from Table A1 or A2.

A3.5.5 Operating Schedules

The default operating schedule of a space should be selected from Tables A3 to A10 below. The schedules are typical of the building type as determined by the designer. Required schedules should be identical for the designed building and reference building. Operating schedules other than the default values are allowed but should be clearly defined and justified.

A3.5.6 Internal Loads

- (a) **Occupancy**. Occupancy schedules should be default assumptions. The same assumptions should be made in computing design energy consumption as are used in calculating the energy budget. Occupancy levels vary by building type and time of day. Tables A1 and A2 summarise the density presented that will be used by each building and space type. Tables A3 to A10 establish the percentage of the people that are in the building by hours of the day for each building type.
- (b) **Lighting**. Interior lighting power density for calculating the energy budget should be similar to the methodology in Section 5. The lighting power used to calculate the design energy should be the actual adjusted power of the lighting design. If the lighting controls in the design are more energy efficient than those required by Section 5, the actual installed lighting power should be used along with the schedules reflecting the action of the controls to calculate the design energy consumption. Lighting levels in buildings vary based on the type of uses within buildings, by area and by time of day. Tables A3 to A10 contain the lighting energy profiles which establish the percentage of the lighting load that is ON in a building by hour of the day. Where there are specific requirements in Section 5, the component efficiency in the reference building should be adjusted to the lowest efficiency level allowed by the requirement for that component type.

Preliminary Draft

- (c) **Equipment.** Equipment loads and profiles are default assumptions. The same assumptions should be made in calculating design energy as are used in calculating the energy budget. Equipment loads include all general service loads that are typical in a building. These loads should include additional process electrical usage, but exclude air-conditioning primary or auxiliary electrical usage. Tables A1 and A2 establish the density in W/m^2 to be used. The equipment energy profiles should be determined using Tables A3 to A10.

A3.5.7 Building Envelope

- (a) **Infiltration.** Infiltration assumptions should use the prescribed assumptions for calculating the total energy budget and default assumptions for the design energy consumption. Infiltration should impact only perimeter zones. When the air-conditioning system is ON, no infiltration should be assumed to occur. When the air-conditioning system is OFF, the infiltration rate for exterior walls of the building with entrance doors/revolving doors or with operable windows should be assumed to be: (i) for glazed entrance doors and for revolving doors, 5 L/s per m^2 of door area, and (ii) for operable windows, 2 L/s per m^2 of the respective window area.
- (b) **Envelope and Ground Absorptivities.** Absorptivity assumptions should be prescribed assumptions for the reference building and default assumptions for the designed building. The solar absorptivity of opaque elements of the building envelope should be assumed to be 70 percent. The solar absorptivity of ground surfaces should be assumed to be 80 percent (20 percent reflectivity).
- (c) **Window Management.** If the plans and specifications show interior shading devices which perform better than a medium-colored Venetian blind, then those shading devices may be modelled in the designed building, and the reference building should be modelled with medium-colored Venetian blinds. Otherwise, interior shading should be modelled identically in the proposed and reference buildings, either with medium-colored Venetian blinds or without interior shades.
- (d) **Shading.** For reference buildings and the designed building, shading by permanent structures, terrain, and vegetation may be taken into account for computing energy consumption, whether or not these features are located on the building site. A permanent fixture is one that is likely to remain for the life of the proposed design.
- (e) **Window Areas.** The fraction of total window area in each orientation should be equal for both the reference and designed building. For example, if the designed building has 40% of window area facing north, then the reference building should also have 40% of window area facing north.
- (f) **Thermal Mass.** If no information is available for determining the thermal mass of the building envelope, medium weight construction should be assumed in the modelling.

A3.5.8 Air-conditioning Systems

- (a) **Thermal Blocks and Air-conditioning Zones.** Thermal blocks for the reference building and designed building should be identical. Where air-conditioning zones are defined on

Preliminary Draft

air-conditioning design documents, each air-conditioning zone should be modelled as a separate thermal block. Different air-conditioning zones may be combined to create a single thermal block or identical thermal blocks to which multipliers are applied provided all of the following conditions are met:

- i) The space use classification is the same throughout the thermal block.
 - ii) All air-conditioning zones in the thermal block that are adjacent to glazed exterior walls face the same orientation or their orientations are within 45 degrees of each other.
 - iii) All of the zones are served by the same air-conditioning system or by the same kind of air-conditioning system.
- (b) ***Air-conditioning Zones Not Designed.*** Where the air-conditioning zones and systems have not yet been designed, thermal blocks should be defined based on similar internal load densities, occupancy, lighting, thermal and space temperature schedules, and in combination with the following guidelines:
- i) Separate thermal blocks should be assumed for interior and perimeter spaces. Interior spaces should be those located greater than 4 m from an exterior wall. Perimeter spaces should be those located closer than 4 m from an exterior wall.
 - ii) Separate thermal blocks should be assumed for spaces adjacent to glazed exterior walls; a separate zone should be provided for each orientation, except orientations that differ by no more than 45 degrees may be considered to be the same orientation. Each zone should include all floor area that is 4 m or less from a glazed perimeter wall, except that floor area within 4 m of glazed perimeter walls having more than one orientation should be divided proportionately between zones.
 - iii) Separate thermal blocks should be assumed for spaces having floors that are in contact with the ground or exposed to ambient conditions from zones that do not share these features.
 - iv) Separate thermal blocks should be assumed for spaces having exterior ceiling or roof assemblies from zones that do not share these features.
- (c) ***Supply Air Flow Rates.*** The design air flow rate for each thermal block of the designed building should be automatically calculated by the simulation program based on the design cooling supply air temperature and heating supply air temperature.
- (d) ***Performance Parameters.*** The air-conditioning system's performance parameters for the reference building should be determined from the following rules:
- i) Components and parameters not specifically addressed in Section 9 or this Appendix should be identical to those in the designed building. Where there are specific requirements in Section 6, the component efficiency in the reference building should be adjusted to the lowest efficiency level allowed by the requirement for that component type.
 - ii) All air-conditioning equipment in the reference building should be modelled at the minimum efficiency levels, both part load and full load, in accordance with the requirements in Section 6.
 - iii) Where equipment efficiency ratings include fan energy, the descriptor should be broken down into its components so that supply fan energy can be modelled separately.
 - iv) Minimum outdoor air ventilation rates should be the same for both the reference

Preliminary Draft

- building and designed building.
- v) System design supply air flow rates for the reference building should be based on a supply-air-to-room-air temperature difference of 11°C. If return or relief fans are specified in the designed building, the reference building should also be modelled with the same fan type sized for the reference system supply fan air quantity less the minimum outdoor air, or 90% of the supply fan air quantity, whichever is larger.
 - vi) Fan system efficiency (kW per L/s of supply air including the effect of belt losses but excluding motor and motor drive losses) should be the same as the designed building or up to the limit prescribed in Section 6, whichever is smaller.
 - vii) The equipment capacities for the reference building design should be sized proportionally to the capacities in the designed building based on sizing runs; i.e., the ratio between the capacities used in the annual simulations and the capacities determined by the sizing runs should be the same for both the designed building and reference building. Unmet load hours for the designed building should not differ from unmet load hours for the reference building design by more than 50 hours.

A3.5.9 Service Water Heating

- (a) **Loads.** The service water heating loads for reference buildings are defined in Tables A1 and A2. The same service water heating load assumptions should be made in calculating design energy as are used in calculating the energy budget.
- (b) **Fuels.** The fuel assumed for the service water heating equipment of the reference building should be the same as that for the designed building.

A3.5.10 Controls

- (a) **Space Temperature Controls.** Space temperature controls for the reference building should be the same as the designed building. The system should be OFF during off-hours according to the appropriate schedule in Tables A3 to A10.
- (b) **Throttling Range.** The throttling range of room thermostat should be set to no greater than 1°C.
- (c) **Outside Air Ventilation.** When providing for outdoor air ventilation when calculating the energy budget, controls should be assumed to close the outside air intake to reduce the flow of outside air to zero during 'setback' and 'unoccupied' periods. Ventilation using inside air may still be required to maintain scheduled setback temperature.

A3.5.11 Speculative Buildings

- (a) **Lighting.** The interior lighting power density for calculating the total energy budget should be determined from Tables A1 and A2. The design energy consumption may be based on an assumed adjusted lighting power for future lighting improvements. The assumption about future lighting power used to calculate the design energy consumption should be documented so that the future installed lighting systems may be in compliance with this assumption.

Preliminary Draft

- (b) ***Air-conditioning Systems and Equipment.*** If the air-conditioning system is not completely specified in the plans, the design energy consumption should be based on reasonable assumptions about the construction of future air-conditioning systems and equipment. These assumptions should be documented so that future air-conditioning systems and equipment may be in compliance with this assumption.

*Preliminary Draft***Table A1 Building type categories: default assumptions**

Building Type	Occupant Density (m ² /person)	Minimum Outdoor Air (L/s/psn)	Operating Schedule (Table A3 to A10)	Lighting Power Density (W/m ²)	Equipment Power Density (W/m ²)	Service Water Heating (W/person)
Office	13	8	A	15	10	As design
Restaurant	5	10	B	21	20 W/psn(*)	As design
Retail	10	8	C	18	---	As design
Mall/Concourse/Atria	10	1 L/s/m ²	C	23	---	As design
Hotel	25	30 L/s per rm	D	17	900W per rm	500

Note: * 10 W per person for sensible heat and 10 W per person for latent heat.

Table A2 Space type categories: default assumptions

Building Type	Occupant Density (m ² /person)	Minimum Outdoor Air (L/s/psn)	Operating Schedule (Tables A3 to A10)	Lighting Power # Density (W/m ²)	Equipment Power Density (W/m ²)	Service Water Heating (W-person)
Office				Table 5.4 in Section 5		
General	8	8	A		25	As design
Hi-tech	8	8	A		50-70	As design
Lift lobby	10	1 L/s/m ²	A		---	As design
Reception/Waiting/ Recreation room	8	8	A		---	As design
Data centre (server, mainframe computer)	10-15	8	A		500-900	As design
Bank business area	10	8	A		30	As design
Bank customer area	1.5	0.25 L/s/m ²	A		---	As design
Restaurant				Table 5.4 in Section 5		
Chinese restaurant	1	10	B		20 W/psn *	As design
Western restaurant	1.5	10	B		20 W/psn *	As design
Coffee shop/ Bar/ Lounge (smoking allowed)	1.5	15	B		10	As design
Canteen/food plaza	1	10	B		20 W/psn *	As design
Kitchen	As design	As design	As design		As design	As design
Retail				Table 5.4 in Section 5		
Retail shop	2.5	8	C		30	As design
Shopping arcade	2.5	8	C		10	As design
Supermarket	12.5	8	C	5-10	As design	
Educational activities				Table 5.4 in Section 5		
Classroom/Lecture theatre/Laboratory	2 (or no. of seat)	8	A		10	As design
Library	5	8	A		10	As design
Mass assembly area				Table 5.6 in		
Auditorium	5	8	C		5-10	As design

Preliminary Draft

Building Type	Occupant Density (m ² /person)	Minimum Outdoor Air (L/s/psn)	Operating Schedule (Tables A3 to A10)	Lighting Power # Density (W/m ²)	Equipment Power Density (W/m ²)	Service Water Heating (W-person)
Exhibition hall /gallery	5	8	C	Section 5	5-10	As design
Mass assembly area/assembly hall	1	8	E		5-10	As design
Theatre – Performing arts	2 (or no. of seat)	8	E		---	As design
Theatre – Motion picture	2 (or no. of seat)	8	E		---	As design
Indoor sports grounds				Table 5.4 in Section 5		
Spectator seating area	1.5	8	F		---	As design
Indoor sports ground for amateur players	3	13	F		---	As design
Indoor sports ground for tournament	As design	13	F		---	As design
Squash courts for amateur players	2 persons	13	F		---	As design
Squash courts for tournament	2 persons	13	F		---	As design
Indoor swimming pool for amateur players	3	13	F		---	As design
Indoor swimming pool for tournament	As design	13	F		---	As design
Ice rink for amateur players	3	13	F		---	As design
Ice rink for tournament	As design	13	F		---	As design
Hotel				Table 5.4 in Section 5		
Banquet room	1	10	B		20 W/psn(*)	90
Back-of-house area	4	8	G		20 W/psn(*)	60
Main entrance/large lobby	10	1 L/s/m ²	G		---	30
Health club	8-10	13	F		---	90
Guest rooms	As design (or 2 per rm)	30 L/s/room	D		900W per room	500

Note: * 10 W per person for sensible heat and 10 W per person for latent heat.

Use values in Table 5.4 in Section 5 for spaces not listed in this table.

*Preliminary Draft***Table A3 : Operating schedule 'A': offices**

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0	0	0	0	0	0	0.1	0.7	0.9	0.9	0.9	0.5	0.5	0.9	0.9	0.9	0.7	0.3	0.1	0.1	0.1	0.1	0	0
Sat	0	0	0	0	0	0	0.1	0.4	0.7	0.7	0.7	0.7	0	0	0	0	0	0	0	0	0	0	0	0
Sun	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Equipment																								
Mon – Fri	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.8	0.5	0.3	0.2	0.2	0.2	0.2
Sat	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.8	0.9	0.9	0.9	0.9	0.9	0.8	0.6	0.5	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Sun	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Lighting																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.8	0.5	0.3	0.1	0.05	0.05	
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.8	0.9	0.9	0.9	0.9	0.9	0.8	0.6	0.5	0.3	0.3	0.1	0.1	0.05	0.05	0.05	
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	
Fans																								
Mon – Fri	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off	Off	Off
Sat	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Cooling	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off	Off	Off
Sat	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Heating	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off	Off	Off
Sat	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off
Hot Water																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.1	0.5	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.5	0.3	0.2	0.2	0.2	0.05	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.1	0.5	0.5	0.9	0.9	0.9	0.9	0.9	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05

Table A4 : Operating schedule 'B-1': western restaurants

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0.1	0	0	0	0	0	0	0	0.1	0.2	0.5	0.9	0.9	0.8	0.2	0.2	0.3	0.6	0.9	0.9	0.9	0.6	0.4	0.3
Sat	0.3	0	0	0	0	0	0	0	0.1	0.2	0.5	0.9	0.9	0.8	0.2	0.2	0.3	0.6	0.9	0.9	0.9	0.6	0.6	0.5
Sun	0.3	0	0	0	0	0	0	0	0.3	0.4	0.7	0.9	0.9	0.9	0.7	0.5	0.4	0.6	0.9	0.9	0.9	0.5	0.4	0.3
Equipment																								
Mon – Fri	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.5	0.5
Lighting																								
Mon – Fri	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.5	0.5
Fans																								
Mon – Fri	On	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sat	On	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sun	On	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Cooling	(*) = temperature as design																							
Mon – Fri	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Heating	(*) = temperature as design																							
Mon – Fri	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Hot Water																								
Mon – Fri	0.5	0.05	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.5	0.5	0.6	0.6	0.5	0.3	0.3	0.5	0.5	0.8	0.8	0.9	0.9	0.6
Sat	0.6	0.05	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.5	0.5	0.6	0.6	0.5	0.3	0.3	0.5	0.5	0.8	0.8	0.9	0.9	0.7
Sun	0.6	0.05	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.5	0.5	0.6	0.6	0.5	0.3	0.3	0.5	0.5	0.8	0.8	0.9	0.9	0.5

*Preliminary Draft***Table A5 : Operating schedule 'B-2': Chinese restaurants**

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0	0	0	0	0	0	0.5	0.7	0.7	0.5	0.5	0.9	0.9	0.8	0.2	0.2	0.3	0.6	0.9	0.9	0.8	0.3	0.1	0
Sat	0	0	0	0	0	0	0.4	0.6	0.7	0.6	0.6	0.8	0.9	0.8	0.2	0.2	0.3	0.6	0.9	0.9	0.8	0.3	0.1	0
Sun	0	0	0	0	0	0	0.4	0.6	0.7	0.8	0.8	0.9	0.9	0.9	0.7	0.5	0.4	0.6	0.9	0.9	0.8	0.3	0.1	0
Equipment																								
Mon – Fri	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.4	0.5	0.7	0.9	0.9	0.9	0.8	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.7	0.3	0.1
Sat	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.4	0.5	0.7	0.9	0.9	0.9	0.8	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.7	0.3	0.1
Sun	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.4	0.7	0.7	0.9	0.9	0.9	0.9	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.7	0.3	0.1
Lighting																								
Mon – Fri	0.1	0.1	0.1	0.1	0.1	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.1
Sat	0.1	0.1	0.1	0.1	0.1	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.1
Sun	0.1	0.1	0.1	0.1	0.1	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.1
Fans																								
Mon – Fri	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sat	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sun	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Cooling	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Heating	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Hot Water																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.7	0.7	0.7	0.8	0.9	0.7	0.3	0.3	0.3	0.5	0.6	0.8	0.8	0.5	0.3	0.1
Sat	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.7	0.7	0.7	0.8	0.9	0.7	0.3	0.3	0.3	0.5	0.6	0.8	0.8	0.5	0.3	0.1
Sun	0.05	0.05	0.05	0.05	0.05	0.7	0.7	0.7	0.8	0.8	0.9	0.9	0.9	0.9	0.7	0.5	0.5	0.6	0.8	0.8	0.8	0.5	0.3	0.1

Table A6 : Operating schedule 'C': retails

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0	0	0	0	0	0	0	0.1	0.2	0.5	0.5	0.7	0.7	0.7	0.7	0.8	0.7	0.6	0.5	0.4	0.3	0	0	0
Sat	0	0	0	0	0	0	0	0.1	0.2	0.5	0.6	0.7	0.7	0.9	0.9	0.9	0.8	0.8	0.8	0.7	0.6	0	0	0
Sun	0	0	0	0	0	0	0	0	0.1	0.3	0.6	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.8	0.7	0.6	0	0
Equipment																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Lighting																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.5	0.5	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.05	0.05	0.05
Fans																								
Mon – Fri	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Sat	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Cooling	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Sat	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Heating	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Sat	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off	Off
Hot Water																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.1	0.2	0.3	0.4	0.8	0.8	0.8	0.8	0.6	0.4	0.3	0.2	0.2	0.2	0.05	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.1	0.2	0.3	0.5	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.7	0.5	0.4	0.05	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.1	0.3	0.4	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.7	0.5	0.4	0.05	0.05	0.05

*Preliminary Draft***Table A7 : Operating schedule 'D': hotels**

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	
Occupants																									
Mon – Fri	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.4	0.4	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.5	0.5	0.5	0.7	0.7	0.8	0.9	0.9	
Sat	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.5	0.5	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.5	0.6	0.6	0.6	0.7	0.7	0.7	
Sun	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.2	0.2	0.2	0.3	0.4	0.4	0.6	0.6	0.8	0.8	0.8	
Equipment																									
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.4	0.4	0.4	0.5	0.5	0.6	0.5	0.3	
Sat	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.3	0.4	0.4	0.4	0.2	0.2	0.2	
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.3	0.3	0.4	0.4	0.2	0.2	0.2	
Lighting																									
Mon – Fri	0.2	0.2	0.1	0.1	0.1	0.2	0.4	0.5	0.4	0.4	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.6	0.8	0.9	0.8	0.6	0.3
Sat	0.2	0.2	0.1	0.1	0.1	0.1	0.3	0.3	0.4	0.4	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.6	0.7	0.7	0.7	0.6	0.3
Sun	0.3	0.3	0.2	0.2	0.2	0.2	0.3	0.4	0.4	0.3	0.3	0.3	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.5	0.7	0.8	0.6	0.5	0.3
Fans																									
Mon – Fri	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sat	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sun	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Cooling	(*) = temperature as design																								
Mon – Fri	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Heating	(*) = temperature as design																								
Mon – Fri	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Hot Water																									
Mon – Fri	0.3	0.2	0.1	0.1	0.2	0.4	0.6	0.9	0.7	0.5	0.5	0.4	0.5	0.4	0.3	0.3	0.3	0.3	0.5	0.7	0.7	0.7	0.7	0.5	
Sat	0.3	0.2	0.1	0.1	0.2	0.4	0.5	0.8	0.6	0.5	0.5	0.5	0.5	0.5	0.4	0.3	0.3	0.3	0.5	0.7	0.7	0.7	0.7	0.5	
Sun	0.3	0.2	0.1	0.1	0.2	0.4	0.4	0.6	0.9	0.7	0.5	0.5	0.5	0.4	0.3	0.3	0.3	0.3	0.4	0.6	0.6	0.6	0.6	0.5	

Table A8 : Operating schedule 'E': theatres

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0	0	0	0	0	0	0	0	0	0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.6	0.8	0.8	0.8	0.5	0	0
Sat	0	0	0	0	0	0	0	0	0	0.5	0.6	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0	0
Sun	0	0	0	0	0	0	0	0	0	0.5	0.6	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0	0
Equipment																								
Mon – Fri	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Sat	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Sun	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Lighting																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Fans																								
Mon – Fri	Off	Off	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Sat	Off	Off	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off	Off
Cooling	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sat	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Heating	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sat	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sun	Off	Off	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Hot Water																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.2	0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.6	0.8	0.8	0.8	0.5	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.6	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.6	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0.05	0.05

*Preliminary Draft***Table A9 : Operating schedule 'F': sports**

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0	0	0	0	0	0	0.3	0.4	0.5	0.5	0.5	0.3	0.3	0.3	0.4	0.5	0.5	0.6	0.8	0.8	0.8	0.5	0	0
Sat	0	0	0	0	0	0	0.3	0.4	0.5	0.7	0.8	0.7	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.5	0	0
Sun	0	0	0	0	0	0	0.3	0.4	0.5	0.7	0.8	0.7	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.5	0	0
Equipment																								
Mon – Fri	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.5	0.5	0.9	0.9	0.5	0.5	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Sat	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.7	0.7	0.9	0.9	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Sun	0.1	0.1	0.1	0.1	0.1	0.1	0.7	0.7	0.9	0.9	0.9	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.7	0.7	0.1	0.1
Lighting																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.05	0.05
Fans																								
Mon – Fri	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off
Sat	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off
Sun	Off	Off	Off	Off	Off	Off	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	Off	Off
Cooling	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sat	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sun	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Heating	(*) = temperature as design																							
Mon – Fri	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sat	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Sun	Off	Off	Off	Off	Off	Off	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	Off	Off
Hot Water																								
Mon – Fri	0.05	0.05	0.05	0.05	0.05	0.05	0.2	0.3	0.4	0.5	0.5	0.3	0.3	0.3	0.5	0.5	0.5	0.6	0.8	0.8	0.8	0.5	0.05	0.05
Sat	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.6	0.7	0.7	0.5	0.5	0.5	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0.05	0.05
Sun	0.05	0.05	0.05	0.05	0.05	0.05	0.3	0.5	0.6	0.8	0.8	0.5	0.5	0.5	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.5	0.05	0.05

Table A10 : Operating schedule 'G': common activities areas

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Occupants																								
Mon – Fri	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Equipment																								
Mon – Fri	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Lighting																								
Mon – Fri	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Fans																								
Mon – Fri	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sat	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Sun	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On	On
Cooling	(*) = temperature as design																							
Mon – Fri	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Heating	(*) = temperature as design																							
Mon – Fri	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sat	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Sun	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)	(*)
Hot Water																								
Mon – Fri	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sat	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
Sun	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9

Preliminary Draft

- End -